

Water and Wastewater Pump Replacement Industry Standard Practice & Measure Package Update

Final Report

ET24SWE0038



Prepared by:

Cristalle Mauleon, Lincus, Inc.

December 10, 2024

Acknowledgements

SCE Measure Development Team, SCE, for facilitating documentation reviews, collaboration with PG&E and CPUC on Measure Package clarifications, and submissions to CPUC.

Hydraulic Institute for providing their database of compliant pump models of the Department of Energy's Pump Energy Conservation Standards and participation in the market-based Industry Standard Practice Study.

Disclaimer

The CalNEXT program is designed and implemented by Cohen Ventures, Inc., DBA Energy Solutions ("Energy Solutions"). Southern California Edison Company, on behalf of itself, Pacific Gas and Electric Company, and San Diego Gas & Electric® Company (collectively, the "CA Electric IOUs"), has contracted with Energy Solutions for CalNEXT. CalNEXT is available in each of the CA Electric IOU's service territories. Customers who participate in CalNEXT are under individual agreements between the customer and Energy Solutions or Energy Solutions' subcontractors (Terms of Use). The CA Electric IOUs are not parties to, nor guarantors of, any Terms of Use with Energy Solutions. The CA Electric IOUs have no contractual obligation, directly or indirectly, to the customer. The CA Electric IOUs are not liable for any actions or inactions of Energy Solutions, or any distributor, vendor, installer, or manufacturer of product(s) offered through CalNEXT. The CA Electric IOUs do not recommend, endorse, qualify, guarantee, or make any representations or warranties (express or implied) regarding the findings, services, work, quality, financial stability, or performance of Energy Solutions or any of Energy Solutions' distributors, contractors, subcontractors, installers of products, or any product brand listed on Energy Solutions' website or provided, directly or indirectly, by Energy Solutions. If applicable, prior to entering into any Terms of Use, customers should thoroughly review the terms and conditions of such Terms of Use so they are fully informed of their rights and obligations under the Terms of Use, and should perform their own research and due diligence, and obtain multiple bids or quotes when seeking a contractor to perform work of any type.



Executive Summary

The existing SWWP004-03 Measure Package currently applies only to pumps used for clean water applications, even though similar pump types are also used in wastewater applications. The reason why wastewater pumps were not considered initially is because the baseline Pump Energy Index (PEI) criteria used in the Measure Package is from the Department of Energy (DOE)-developed Energy Conservation Standards. These standards only apply to their definition of "clean water pumps."

Wastewater pumping of water treated to secondary treatment standards or better meets the DOE definition, but is not necessarily subject to the standard. Additionally, any wastewater pumps cleared of rags, grit, and other solids that cannot pass through a bar screen are of similar design to wastewater pumps located in subsequent treatment processes at a wastewater treatment plant. Therefore, non-solids handling wastewater pumps also go through the same PEI testing as clean water pumps. This creates a critical need for a comparable measure package for wastewater pumps, to encourage the adoption of high-efficiency pumps in the wastewater market segment. A previous CalNEXT Emerging Technologies (ET) study — ET23SWE0039: Wastewater Pump Measure Development — also identified this gap, recommending the development of a deemed measure package for wastewater pumps. One purpose of this market study is to establish the industry standard practice (ISP) baseline PEI rating for both clean water and wastewater pumps for future measure package updates. The second purpose is to use the ISP findings to update the existing SWWP004 Measure Package.

To conduct the ISP study, the project team developed several survey questionnaires targeting a range of stakeholders, including end-use customers, pump and variable frequency drive (VFD) manufacturers, distributors, installers, pump testers, and subject matter experts. The intent of the surveys was to obtain feedback from pump professionals on their knowledge of the DOE Energy Conservation Standards, the end-use customer markets they serve, common pump model purchases, and the drivers for pump equipment purchases. Participant outreach targeted at least 16 survey participants, covering pumps being installed in agricultural, commercial, industrial, municipal (clean water), residential, and wastewater applications and all pump classes.

Survey results show that a majority of pump end-use customers are not aware of the PEI rating, and pump efficiency tends to be a secondary factor in the decision-making process when purchasing new pumps. The key factors driving purchase decisions are pump reliability and initial cost. Additionally, even vendors familiar with the PEI rating often do not include it in equipment specifications or recommend pumps based on this rating. Only one survey respondent was knowledgeable about the PEI ratings of commonly sold pumps in California, and this individual relied on data from the Northwest Energy Efficiency Alliance (NEEA) to determine PEIs.

Vendors contacted for this study did not provide pump sales data nor PEI ratings of commonly sold pumps in California. The project team received a summary of sales data from six pump manufacturers in the Northwest region from the 2021 and 2022 period. This data, collected from distributors participating in NEEA's Extended Motor Products (XMP) program, includes average PEIs for all pumps sold by these manufacturers. The data is categorized by pump types and maximum pump speed for constant speed pumps. The average PEIs from this sales data ranks at the 76th percentile of pump PEIs listed in the DOE's Pump Compliance Certification Database, meaning only



about 24 percent of pumps listed in the DOE database are more efficient than the average PEIs from the NEEA sales database. This suggests that the XMP sales data does not accurately represent what pump sales would look like without an incentive program in place.

Survey responses revealed differences between pumps sold for the wastewater market and those for the clean water market. However, there is no indication that the rated PEIs of wastewater pumps differ from those of clean water pumps.

Based on the above discussions, it is recommended to use the recent DOE Pump Compliance Certification Database to update the baseline PEI values in the SWWP004 Measure Package for clean water and wastewater pumps. It is also recommended to establish the baseline PEI values at the 25th percentile of the DOE database for each pump size range and control strategy. This approach balances the survey results, which indicated that customers are largely unaware of PEIs and do not consider PEI in their purchasing decisions, and the PEI ratings of all pumps in the DOE database that exceeded the minimum DOE standards.



Abbreviations and Acronyms

| Acronym | Meaning |
|---------|---|
| CPUC | California Public Utilities Commission |
| DOE | Department of Energy |
| ECS | Energy Conservation Standard |
| EE | Energy Efficiency |
| ESCC | End Suction Closed Coupled |
| ESFM | End Suction Frame Mounted |
| ET | Emerging Technology |
| eTRM | Electronic Technical Reference Manual |
| НІ | Hydraulic Institute |
| HP | Horsepower |
| HTR | Hard-to-Reach |
| IL | In-line |
| IOU | Investor-Owned Utility |
| ISP | Industry Standard Practice |
| kWh | Kilowatt-hour |
| NEEA | Northwest Energy Efficiency Alliance |
| PA | Program Administrator |
| PEI | Pump Energy Index |
| PG&E | Pacific Gas & Electric |
| RSV | Radially split, multistage, vertical, in-line casing diffuser |
| SCE | Southern California Edison |



| Acronym | Meaning |
|---------|----------------------------|
| ST | Submersible Turbine |
| TPM | Technology Priority Map |
| WWTP | Wastewater Treatment Plant |



Table of Contents

| Acknowledgements | i |
|---|-----|
| Executive Summary | ii |
| Abbreviations and Acronyms | ٠١ |
| Introduction | 5 |
| Background | 10 |
| Objectives | 15 |
| Methodology and Approach | 16 |
| ISP Study | 17 |
| Participant Demographics | 17 |
| Variation in Wastewater Pumps | 19 |
| Key Criteria Considered by Customers When Purchasing New Pumps | |
| PEI Rating Awareness | 20 |
| Common Pumps in the Market | 23 |
| Market Data | 26 |
| ISP Findings | 33 |
| Measure Package Update | 34 |
| Technology Summary | 34 |
| Measure Case Description | 35 |
| Base Case Description | 39 |
| Code Requirements | 44 |
| Program Requirements | |
| Data Collection Requirements | 49 |
| Electric Savings (kWh) | |
| Peak Electric Demand Reduction (kW) | |
| Gas Savings (Therms) | |
| Life Cycle | 54 |
| Base Case Material Cost (\$/Unit) | |
| Measure Case Material Cost (\$/Unit) | |
| Base Case Labor Cost (\$/Unit) | 56 |
| Measure Case Labor Cost (\$/Unit) | |
| Net-to-Gross | |
| Gross Savings Installation Adjustment | |
| Non-Energy Impacts | |
| DEER Differences Analysis | |
| Stakeholder Feedback | |
| Next Steps | |
| References | |
| Appendix A: ISP Survey Questionnaire | |
| Appendix B: ISP Survey Responses | 69 |
| List of Tables | |
| | 4.5 |
| Table 1: Comparison of Baseline PEI with Measure PEI by Statewide Measure Package Version | |
| Table 2: SWWP004-03 Base Case Descriptions and Comparison of Baseline and Measure PEls | |
| Table 3: Survey Participants' Characteristics | |
| Table 4: Survey Participants' Characteristics | |
| Table 5: Survey Participants' Experience | |
| Table 6: Common PEI Ratings | 25 |



| Table 7: XMP Sales Data Provided to RTF | 27 |
|---|----|
| Table 8: XMP Sales Data vs. SWWP005 HP Bins | 28 |
| Table 9: Number of Pumps in DOE Pump Compliance Certification Database | 28 |
| Table 10: Comparison of Average PEIs for Participating and Non-Participating Pump Manufacturers | |
| | 29 |
| Table 11: XMP Sales Data Percentiles | 30 |
| Table 12: Comparison of PEI values | 33 |
| Table 13: Emerging Technologies Study | 35 |
| Table 14: Measure Case Description | |
| Table 15: Base Case Description | |
| Table 16: Applicable State and Federal Codes and Standards | |
| Table 17: Measure Implementation Eligibility | |
| Table 18: Eligible Building Types and Sectors | 48 |
| Table 19: Data Collection Requirements for Incentived Heat Pump Equipment | |
| Table 20: Annual Unit Energy Consumption – Electric, Baseline | |
| Table 21: Annual Unit Energy Savings - Electric | 51 |
| Table 22: Constants – Annual Operating Hours and Adjustment Factors | |
| Table 23: Pump Parameters | |
| Table 24: Effective Useful Life and Remaining Useful Life | |
| Table 25: Incremental Cost | |
| Table 26: Costs - Calculation Inputs | |
| Table 27: Net to Gross Ratio - Nonresidential | |
| Table 28: Gross Savings Installation Adjustments - Default | |
| Table 29: DEER Difference Summary | 57 |
| | |
| List of Figures | |
| Figure 1: Wastewater treatment plant process diagram | |
| Figure 2: Key pump purchase criteria for customers | |
| Figure 3: Percentage (%) of survey participants aware of PEI | |
| Figure 4: PEI rating awareness | |
| Figure 5: Customer purchase criteria based on PEI rating | 23 |
| Figure 6: Most common pump size sold | |
| Figure 7: Number of pumps sold by pump size | |
| Figure 8: Availability of efficient pumps | |
| Figure 9: Number of pumps in DOE Compliance Certification Database by manufacturer | 29 |
| Figure 10: XMP sales data percentiles | 31 |



Introduction

The California Electronic Technical Reference Manual (eTRM) serves as the official repository of California's energy efficiency measure data¹ and is now the sole source for energy efficiency measure package development, submittal, review, and publication. One measure available in the eTRM is the Water Pump Upgrade, Measure ID: SWWP004-03, which involves installation of a clean water pump that exceeds specific Pump Energy Index (PEI) criteria. The PEI represents the pump's weighted average performance at specific load points and normalized with respect to the performance of a minimally compliant pump.

Under Title 10 Section 431.462, the United States (U.S.) Department of Energy (DOE) developed the Energy Conservation Standard (ECS) for commercial, industrial, and agricultural clean water pumps. According to this standard, all constant speed clean water pumps sold on or after January 2020 must have an ECS label with a PEI rating of 1.0 or lower. It is important to note that, since 2016, pumps have been sold with ECS labels that include PEI values, as part of DOE's efforts to standardize pump efficiency requirements and to encourage the market shift toward high-efficiency pumps.

The existing SWWP004-03 Measure Package currently applies only to pumps used for clean water applications, even though similar pump types are also used in wastewater applications and undergo the same rigorous PEI rating tests. This creates a critical need for a comparable measure package for wastewater pumps to encourage the adoption of high-efficiency pumps in the wastewater market segment. A previous CalNEXT Emerging Technologies (ET) study — ET23SWE0039: Wastewater Pump Measure Development — also identified this gap, recommending the development of a deemed measure package for wastewater pumps.

Additionally, the existing SWWP004-03 Measure Package, approved through December 31, 2024, uses the DOE-mandated PEI rating as a measure baseline to calculate the electric energy savings. The California Public Utilities commission (CPUC) has requested to conduct a Market-Based Industry Standard Practice (ISP) study in accordance with the latest CPUC ISP Guidance v3.1²² to establish and update the baseline PEI in future measure package updates. Establishing the true ISP baseline PEI rating for both clean water and wastewater pumps is required for determining the measure baseline and calculating energy savings. This is essential for the design and implementation of new energy efficiency programs and success of existing programs. Therefore, a market-based ISP study is needed to specify the ISP baseline for clean water and wastewater pumps among agricultural customers; municipal clean water and wastewater customers; commercial irrigators; and heating, ventilation, and air-conditioning (HVAC) pumping systems.

² https://file.ac/41sIG rLPis/



¹ https://www.caetrm.com

Background

Nearly one-fifth of electricity generated in California supports water-related end uses³. The U.S. DOE has been developing efficiency standards for numerous equipment types, and recently included water pumps as part of this work. In order to standardize pump efficiency requirements, DOE facilitated an amendment to the Energy Policy and Conservation Act (EPCA) of 1975, Part C of Title III which established the "Energy Conservation Program for Certain Industrial Equipment," including pumps.⁴ The effective date of the rule for pumps was March 28, 2016, but compliance with the standards went into effect on January 27, 2020.⁵ These Energy Conservation Standards apply to commercial, industrial, and agricultural "clean water pumps."

The Hydraulic Institute (HI) published HI 40.6—Methods for Rotodynamic Pump Efficiency Testing and established the pump energy efficiency rating system, PEI, in alignment with the standards. The scope of the standards is specified at 10 CFR 431.464 and 10 CFR 431.465,6 respectively, and concerns what is referred to as clean water pumps.

The following categories and characteristics of clean water pumps are included in the above standards:

- Pump categories
 - End suction frame mounted/own bearings (ESFM);
 - End suction close coupled (ESCC);
 - o In-line (IL);
 - o Radially split, multistage, vertical, in-line casing diffuser (RSV):
 - Submersible turbine (ST);
 - Radially split, multi-stage, horizontal, end-suction diffuser casing (RSHES);
 - o Radially split, multi-stage, horizontal, in-line diffuser casing (RSHIL);
 - Small vertical in-line (SVIL); and
 - Vertical turbine (VT) pumps.
- Pump characteristics

⁶ https://www.ecfr.gov/current/title-10/chapter-II/subchapter-D/part-431/subpart-Y?toc=1



³ California Energy Commission (CEC). 2005. California's Water – Energy Relationship . CEC-700-2005-011-SF. https://www.caetrm.com/media/reference-documents/CEC-700-2005-011-SF.PDF

⁴ S.622 - Energy Policy and Conservation Act of 1975. Title III. Part C. https://www.congress.gov/bill/94th-congress/senate-bill/622/text

⁵ Robinson, Reece. 2019. 2020 Pump Efficiency, DOE Requirements. https://www.pumpsandsystems.com/2020-pump-efficiency-doe-requirements

- Flow rate of 25 gpm or greater at best efficiency point (BEP) and full impeller diameter;
- Maximum head of 459 feet at BEP and full impeller diameter and the number of stages required for testing (see section 1.2.2 of appendix A of §431.464);
- Design temperature range wholly or partially in the range of 15 to 250°F;
- Designed to operate with either:
 - o A two- or four- or six-pole induction motor, or
 - A non-induction motor with a speed of rotation operating range that includes speeds of rotation between 2,880 and 4,320 revolutions per minute (rpm) and/or 1,440 and 2,160 rpm and/or 960 and 1,439 revolutions per minute, and in each case, the driver and impeller must rotate at the same speed;
- For ST, and VT pumps, a six-inch or smaller bowl diameter; and
- For ESCC, and ESFM pumps, a specific speed less than or equal to 5,000 when calculated using U.S. customary units.

A "clean water pump" is defined as a pump that is designed for use in pumping water with a maximum nonabsorbent free solid content of 0.016 pounds per cubic foot, and with a maximum dissolved solid content of 3.1 pounds per cubic foot. This is based on the premise that the total gas content of the water does not exceed the saturation volume and disregards any additives necessary to prevent the water from freezing at a minimum of 14°F. Wastewater treated to the National Pollutant Discharge Elimination System discharge permit limits for surface water discharge exceeds the water quality standard specified by the clean water definition. Wastewater is treated to the point of meeting the clean water definition during secondary treatment, as depicted in stage 5 of Figure 1, which shows the stages of treatment at a typical WWTP (WWTP).



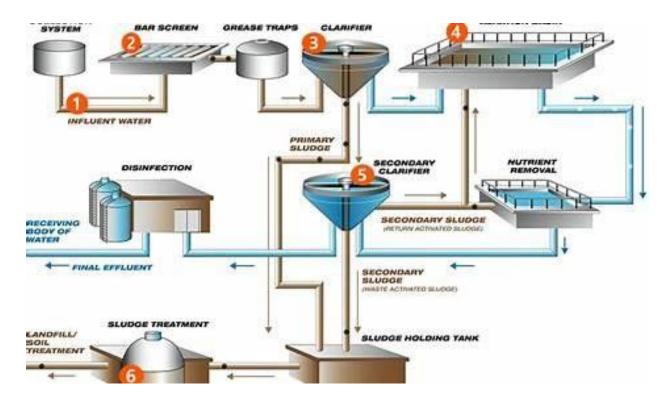


Figure 1: Wastewater treatment plant process diagram

Source: (Avijit Mallik 2018)

Pump models that meet DOE's Pump Energy Conservation Standards are being installed at WWTPs, pumping fluids with solid content that meet the clean water pump definition. These pump applications are not required to meet DOE's ECS. For this reason, they were excluded from the SWWP004 Water Pump Upgrade Measure Package.

As defined by DOE, "clean water pumps" are found in irrigation, wastewater pumping, water distribution systems, and HVAC pumping systems (chiller pumps, boiler plant pumps, and cooling tower pumps). The above standard does not apply to submersible vertical turbine pumps greater than 75 HP, due to bowl diameter limits. While wastewater pumps do not pump clean water and are not applicable to the current offering, both pump types share similar energy efficiency challenges. Including wastewater pumps in the existing deemed offering would address the gap in the measure offering and expand the reach of this measure into the wastewater industry.

The water pump upgrade measure package has had limited historical market adoption despite its availability for program adoption in January 2020, which is when compliance with DOE's ECS for pumps took effect. The baseline PEIs became more efficient from Version 1 to Version 2 of the measure package, as shown in Table 1 below.



Table 1: Comparison of Baseline PEI with Measure PEI by Statewide Measure Package Version7

| Measure Package ID | Effective Dates | Pump Motor Horsepower, Control Strategy | Baseline PEI | Measure PEI |
|-----------------------|-----------------------|---|-----------------|----------------|
| SWWP004-01 | 1/1/20-10/11/22 | 1-200 HP, Constant Speed | 0.96-1.00 | <0.96 |
| SWWP004-02 | 10/12/22-12/31/23 | 1-50 HP, Constant Speed | 0.94 | 0.88 - 0.92 |
| SWWP004-03 | 1/1/24-12/31/24 | 1-50 HP, Constant Speed | 0.94 | 0.88 - 0.92 |
| SWWP004-02 | 10/12/22-12/31/23 | >50-250 HP, Constant Speed | 0.95 | 0.89 - 0.93 |
| SWWP004-03 | 1/1/24-12/31/24 | >50-250 HP, Constant Speed | 0.95 | 0.89 - 0.93 |
| SWWP004-01 | 1/1/20-10/11/22 | 1-200 HP, Variable Speed | 0.49-0.66 | <0.49 |
| SWWP004-02 | 10/12/22-12/31/23 | 1-15 HP, Variable Speed | 0.47 | 0.41 - 0.45 |
| SWWP004-03 | 1/1/24-12/31/24 | 1-15 HP, Variable Speed | 0.47 | 0.41 - 0.45 |
| SWWP004-02 | 10/12/22- 12/31/23 | >15-250 HP, Variable Speed | 0.49 | 0.43 - 47 |
| SWWP004-03 | 1/1/24-12/31/24 | >15-250 HP, Variable Speed | 0.49 | 0.43 -4 7 |

Table 1 shows Version 1 of the measure package used the DOE Pump ECS with a PEI of 1.00 for constant speed pumps and 0.66 for variable load pump as the baseline. However, Version 2 of the measure package reduced the baseline PEI to 0.94-0.95 for constant speed pumps and 0.47-0.49 for variable speed pumps at various pump motor HPs. "Per direction from the CPUC the baseline PEI ratings are representative of the most commonly available (model) of the data set for each control strategy and pump horsepower range".

 $^{^{7}}$ eTRM. SWWP004 Water Pump Upgrade. Base Case Description. Versions 1, 2, and 3.



Version 3 of the Water Pump Upgrade measure package was an extension of Version 2 with cost updates. Therefore, Table 2 below shows the baseline and measure PEIs used in the SWWP004-03 measure package are the same as those in Version 2.

Table 2: SWWP004-03 Base Case Descriptions and Comparison of Baseline and Measure PEIs

| Pump Motor HP Range | Baseline PEI | Measure PEI Range | Control Strategy | Measure ID | Existing/Standard Description |
|---------------------------|-----------------|----------------------|---------------------|---------------|--|
| 1-15 | 0.47 | PEI <= 0.41 | Variable Speed | R | Standard clean water pump, PEI 0.47, variable speed, 1 <= hp <= 15 |
| 1-15 | 0.47 | PEI <= 0.43 | Variable Speed | Q | Standard clean water pump, PEI 0.47, variable speed, 1 <= hp <= 15 |
| 1-15 | 0.47 | PEI <= 0.45 | Variable Speed | Р | Standard clean water pump, PEI 0.47, variable speed, 1 <= hp <= 15 |
| 1-15 | 0.94 | PEI <= 0.88 | Constant Speed | I | Standard clean water pump, PEI 0.94, constant speed, 1 <= hp <= 15 |
| 1-15 | 0.94 | PEI <= 0.90 | Constant Speed | Н | Standard clean water pump, PEI 0.94, constant speed, 1 <= hp <= 15 |
| 1-15 | 0.94 | PEI <= 0.92 | Constant Speed | G | Standard clean water pump, PEI 0.94, constant speed, 1 <= hp <= 15 |
| >15-50 | 0.49 | PEI <= 0.43 | Variable Speed | U | Standard clean water pump, PEI 0.49, variable speed, 15 < hp <= 50 |
| >15-50 | 0.49 | PEI <= 0.45 | Variable Speed | Т | Standard clean water pump, PEI 0.49, variable speed, 15 < hp <= 50 |
| >15-50 | 0.49 | PEI <= 0.47 | Variable Speed | S | Standard clean water pump, PEI 0.49, variable speed, 15 < hp <= 50 |
| >15-50 | 0.94 | PEI <= 0.88 | Constant Speed | L | Standard clean water pump, PEI 0.94, constant speed, 15 < hp <= 50 |
| >15-50 | 0.94 | PEI <= 0.90 | Constant Speed | К | Standard clean water pump, PEI 0.94, constant speed, 15 < hp <= 50 |
| >15-50 | 0.94 | PEI <= 0.92 | Constant Speed | J | Standard clean water pump, PEI 0.94, constant speed, 15 < hp <= 50 |
| >50-250 | 0.49 | PEI <= 0.45 | Variable | W | Standard clean water pump, PEI 0.49, |



| Pump Motor HP Range | Baseline PEI | Measure PEI Range | Control Strategy | Measure ID | Existing/Standard Description |
|---------------------------|-----------------|----------------------|---------------------|---------------|---|
| | | | Speed | | variable speed, 50 < hp <= 250 |
| >50-250 | 0.49 | PEI <= 0.47 | Variable Speed | V | Standard clean water pump, PEI 0.49, variable speed, 50 < hp <= 250 |
| >50-250 | 0.95 | PEI <= 0.89 | Constant Speed | 0 | Standard clean water pump, PEI 0.95, constant speed, 50 < hp <= 250 |
| >50-250 | 0.95 | PEI <= 0.91 | Constant Speed | N | Standard clean water pump, PEI 0.95, constant speed, 50 < hp <= 250 |
| >50-250 | 0.95 | PEI <= 0.93 | Constant Speed | М | Standard clean water pump, PEI 0.95, constant speed, 50 < hp <= 250 |

Source: eTRM. SWWP004-03 Water Pump Upgrade. Base Case Description.

There are issues with using the HI's database of tested pumps to determine the baseline PEI by horsepower range. This provides equal weighting to each pump's model within HI's tested pump database within specified pump motor horsepower ranges, which is a faulty assumption, and skews the baseline PEI results. This method does not consider what market these pumps are meant for, the pump classification differences, pump design flow and head, or which models are commonly being purchased without utility incentive support. Additionally, the process of getting a pump model listed in the HI's database is costly and takes one to two years, so while a pump may be compliant, there is a delay as to when the model ends up being listed, so pumps may be sold and installed, but do not have a listed PEI rating on their pump specifications until they have completed the listing process with HI. The pump manufacturers who completed the testing process first tended to be those with more compliant pump models, while other pump manufacturers needed to perform research and development of their pump models and to discontinue some pump models before they were ready to undergo HI testing. Therefore, the method for determining the baseline PEI in Version 2 and Version 3 of the measure package needs to be reassessed. Since it is unclear what PEI rating is ISP, a market-based study is needed.

Overall, this project will improve the deemed measure offerings by including wastewater pumps, provide a draft version of the Water Pump Updated measure package to extend the measure eligibility beyond 2024, and develop a market-based ISP study to support future versions of the measure package.

Objectives

This project has two primary objectives:



- Conduct a market-based ISP study in accordance with the CPUC guidance to determine the
 baseline pumping PEI ratings for agricultural, municipal clean water and wastewater
 customers, commercial irrigators, and HVAC pumping systems such as chiller pumps, boiler
 plant hot water recycle pumps, and cooling tower systems.
- 2. The original plan for this study included utilizing the findings from the ISP study to update the SWWP004 Water Pump Upgrade Measure Package for program year 2025 and beyond. However, based on recent CPUC guidance, the program year 2025 measure package will be updated using the PEI baseline used in the existing measure package. The findings from the above ISP study will be used for updating the same measure package for program year 2026 and beyond through the next phase of this study.

Methodology and Approach

Survey Questionnaire

The project team developed several ISP study survey questionnaires (see Appendix A: ISP Survey Questionnaire

) targeted for various stakeholders to collect data on pump purchase trends as it relates to the PEI ratings for both clean water and wastewater pumps. The survey questions were curated based on the participant types such as subject matter experts, end-use customers, pump manufacturers, and pump and VFD vendors. The survey questions were also carefully prepared to capture typical current trends in purchasing or practice without directly asking or leading the interviewees toward specific responses. The questionnaire covers a range of topics, from participants' experiences regarding the pumping systems and various market segments to more specific questions on typical purchasing practices based on pump size, market segments, PEI ratings, controls, and more. Additionally, the questionnaire included important criteria influencing pump selection and the availability of high-efficiency pumps. The survey instrument was reviewed and approved by the lead utility (SCE) and the CPUC.

Survey Participants

The project team engaged a range of stakeholders for this study, including water and wastewater customers, pump and VFD manufacturers, vendors, pump testers, installers, and subject matter experts. Interviewees were carefully selected from diverse backgrounds, ensuring they were well-qualified to provide valuable insights into current trends in the purchase, installation, and operation of clean water and wastewater pumps.

Participant Outreach

The primary data collection method consisted of telephone or video calls, with email offered as an alternative if preferred by survey participants. Initial contact with potential candidates was made via email, offering a complimentary \$50 gift card as an incentive for participation. While this outreach generated some responses, a follow-up effort through personal phone calls significantly increased the response rate. Additionally, some interviewees provided referrals to other potential participants,



which further supported recruitment efforts. Table 3 below summarizes the number of participants contacted and recruited from each stakeholder group.

Table 3: Survey Participants' Characteristics

| Stakeholder Type | Number Contacted | Selected for Interview | Completed Interviews |
|----------------------------------|---------------------|------------------------------|-------------------------|
| End-use customer | 5 | 3 | 3 |
| Subject Matter Expert/Consultant | 28 | 6 | 5 |
| Manufacturer | 21 | 4 | 4 |
| Distributor | 9 | 2 | 2 |
| Vendor | 59 | 4 | 3 |
| Totals | 122 | 19 | 17 |

Source: ISP survey responses of 17 participants.

ISP Study

Participant Demographics

The survey aimed to understand participants' experience with relevant pump systems and how their expertise aligned with the survey objectives. The participants were asked general questions about their work with pump systems, including:

- 1. Their years of experience with pump systems.
- 2. The specific "clean water pump" classes their company sells.
- 3. The market sectors they serve.

The survey included five distinct pump classes: end suction close coupled (ESCC), end suction frame mounted (ESFM), in-line close coupled and split coupled pumps (IL), radially split multistage vertical in-line casing diffuser pumps (RSV), and submersible vertical turbines (ST).

The six market sectors specified in the survey are: agricultural, commercial, industrial, municipal, residential, and wastewater.

Table 4 shows the average median, minimum, and maximum of the 15 survey participant responses, and Table 5 shows the various types of experience the participants have in pumping systems.



Table 4: Survey Participants' Characteristics

| Demographics | Average | Median | Minimum | Maximum |
|------------------------|---------|--------|---------|---------|
| Years of Experience | 19.88 | 19 | 5 | 44 |
| # of Pump Classes Sold | 5 | 5 | 5 | 5 |
| Sectors Served | 5 of 6 | 6 | 4 | 6 |

Table 5: Survey Participants' Experience

| Survey Participants | Experience | Years of Experience |
|---------------------|---|---------------------|
| 1 | Managing large municipalities, contracts with cities, design well pumps, booster stations, modifying and engineer new products, alternatives VFDs, improve efficiency | 40 |
| 2 | Testing pumps, irrigation systems, energy efficiency in pumping systems, vibration analysis, pump efficiency test | 35 |
| 3 | Production supervisor/manager, pumping plans, engineering work | 44 |
| 4 | Works with pump manufacturers, stakeholders to go through the HI testing process to add PEI ratings to their pump specifications and facilitates adding the products into the HI Database | 7 |
| 5 | Facilitates the training of the DOE pump conservation standards and collaborates with energy efficiency program offering | 25 |
| 6 | Oversees the team handling the HI testing process and stakeholder training | 20 |
| 7 | Systems integration/selection, component selection, and sales | 7 |
| 8 | Sales and consulting – food and beverage, chemical distribution, bio farm, sanitary, industrial | 11 |
| 9 | Sales – food and beverage | 9 |
| 10 | Sales – centrifugal pumps, wastewater pumps, positive displacement pump manufacturer for industry application | 20 |
| 11 | Consultant firm for energy sector, water treatment, business development, product management | 15 |
| 12 | Repairs, service work | 32 |
| 13 | Consulting for 13 yrs designing pump stations, water and wastewater systems, and currently focusing on optimization of said systems | 19 |
| 14 | Water treatment and pumping operations, extensively in groundwater wells, vertical turbines, booster pumps, inline and split case pumps. No experience in wastewater. | 19 |
| 15 | Developed a program for the Resource Technology Framework (RTF), managing data collection for 400 pumps in the Northwest, including pump characteristics, load profiles, and operational hours. The study was published by the Northwest Energy Efficiency Alliance (NEEA). Launched a midstream program, recruiting manufacturer reps, energy efficiency experts, and PEI professionals, and impact. | 5 |
| 16 | Supervising districts production, Management of pump operating systems including engineering, the repair and upgrade of both well pumps and booster pumps. Management of water treatment for pumping system involved with source water distribution. | 15 |
| 17 | Supervising districts production, Management of pump operating systems including engineering, the repair and upgrade of both well pumps and booster pumps. | 15 |



Variation in Wastewater Pumps

Survey participants with experience in wastewater systems were asked about the differences between clean water and wastewater pumps. All respondents agreed that significant variations exist. These differences include the type of casing and impeller used, with wastewater systems often utilizing grinder pumps, while clean water systems typically rely on low-speed (RPM) vertical turbines. Additionally, participants noted that booster pumps are more commonly used in wastewater facilities than in clean water systems.

Participants also noted that wastewater pumps typically have a larger passthrough capacity and are designed with direct inlets, without the screening commonly found on vertical turbine pumps used in clean water applications. They mentioned that specialized wastewater pumps, such as chopper pumps designed for handling solids, would likely have higher, less efficient PEI ratings if tested. However, pumps used in primary and later stages of wastewater treatment would have PEI ratings similar to those of clean water pumps.

One participant added that their company deals with larger clean water pumps in the 50 to 250 HP range, while the wastewater pumps served are generally smaller, typically in the 15 to 50 HP range. Despite these differences, none of the variations in wastewater pumps were found to affect their PEI rating, as evaluated by the HI.

Key Criteria Considered by Customers When Purchasing New Pumps

The survey investigated the top five criteria customers prioritize when purchasing new pumps. These criteria included:

- Initial cost
- Operating cost/efficiency
- Availability, prior experience/spare parts consistency/manufacturer
- Type consistency, and reliability
- Other

Survey respondents were asked to rank purchasing criteria from 1 to 5 with a rank of 1 being the most important. One respondent noted that "form, fit and function" is a significant factor that falls under the "other" category. The results showed that the most important purchasing criterion was the reliability of the new pump, followed closely by the initial cost. Several participants noted that in cases of unexpected pump failure, the initial cost becomes the primary consideration. After reliability and initial cost, the remaining criteria were ranked in the following order: operating cost/efficiency, availability, and prior experience. These rankings are shown in Figure 2 below.



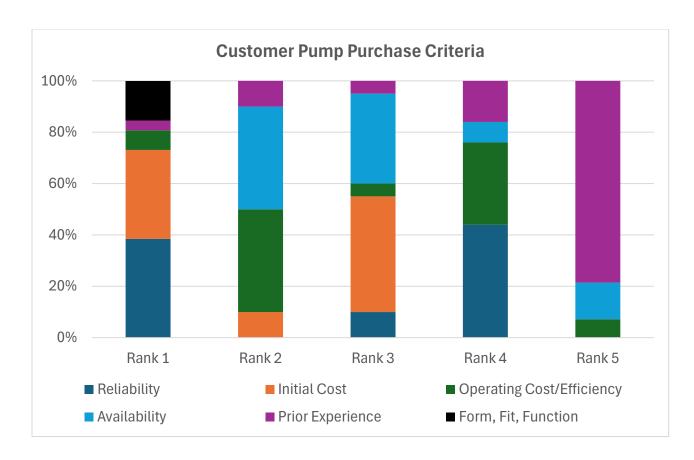


Figure 2: Key pump purchase criteria for customers

The survey results indicate that while customers place high value on the long-term performance and reliability of pumps, short-term financial considerations, such as upfront costs, become critical in urgent situations. Additionally, customers prioritize reliability to ensure the pump will function effectively in their specific applications. Some participants, particularly subject matter experts, emphasized that the most important factor is selecting a pump design that meets the form, fit, and function required to align with the customer's operational needs.

Operating cost and efficiency, which also ranked highly, indicate that while low maintenance costs and energy efficiency are important considerations, they are not the primary focus in purchasing decisions. Availability, ranked between 2 and 4 by different participants, reflects that while access to a pump is important, it is generally less critical since efficient pumps are widely available, according to the survey responses. However, availability becomes more significant when there is an urgent need for a pump. Prior experience with a specific pump type or manufacturer, though still a relevant factor, holds the least weight compared to the other criteria.

PEI Rating Awareness

The survey evaluated the awareness of PEI ratings among survey respondents, including pump/VFD vendors and end-use customers. Out of the 17 survey participants, 20 percent indicated they were not aware of PEI ratings, as illustrated in Figure 3 below. This lack of awareness was predominantly



observed among pump vendors and end-use customers. The 80 percent of respondents who were aware of PEI were subject matter experts and pump vendors.

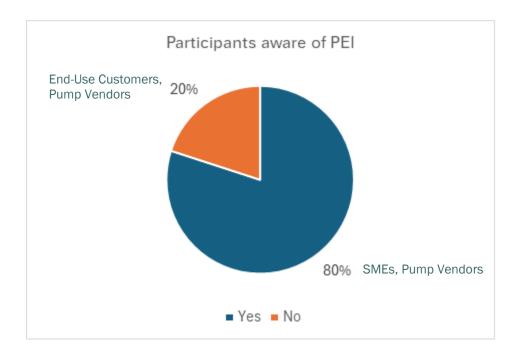


Figure 3: Percentage (%) of survey participants aware of PEI

The survey further explored the awareness of PEI ratings among pump/VFD vendors and end-use customers. Participants generally agreed that most pump vendors are knowledgeable about PEI ratings. However, this awareness is not widely shared with end-use customers. More than 70 percent of respondents indicated that less than 25 percent of end-use customers are aware of the PEI ratings for the pumps they purchase. A visual representation of awareness of PEI rating in vendors and customers is shown below in Figure 4.



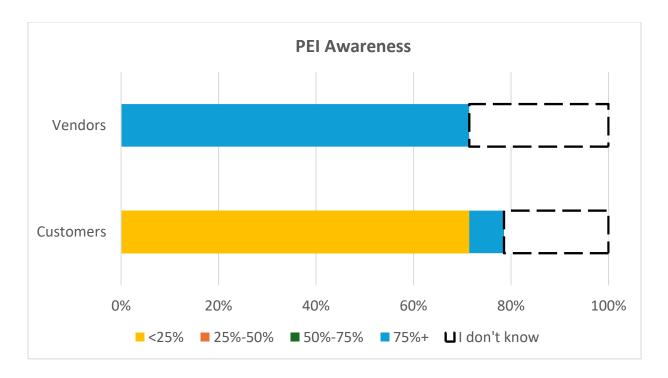


Figure 4: PEI rating awareness

The survey included additional questions regarding the usage of PEI ratings when advising customers on pump models and whether these ratings influence the decision-making process.

While some responses indicated that customers are aware of PEI ratings and that these ratings play a role in their purchasing decisions, the majority of responses suggested the opposite. See results in Figure 5, below.

In fact, interviewees #8 through #12 noted that while PEI is a term known widely in the energy efficiency world, they emphatically said they would **not** use that term to sell a pump because only ten percent of customers would know what it means. Instead, they would talk about the efficiency of the pump in general. For example, Interviewee #1 noted he would use the term Overall Plant Efficiency (OPE) to describe the efficiency of a pump or pumping system. Participants #8 through #12 also said that customers expect their vendors to recommend efficient pumps, so customers do not ask about pump efficiency ratings because it is inherently expected that recommended pumps are efficient.



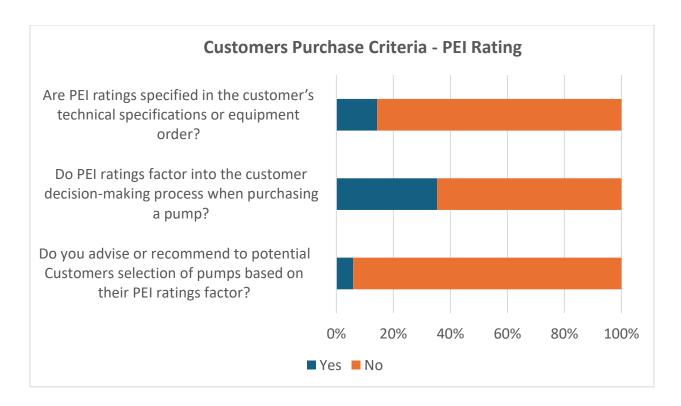


Figure 5: Customer purchase criteria based on PEI rating

The findings suggest a significant gap in the communication of PEI rating information from vendors to end-use customers. While vendors may be informed, the lack of awareness among customers highlights an opportunity for improved education and outreach. This disconnect could hinder customers' ability to make informed purchasing decisions based on energy efficiency, ultimately affecting their operational costs and sustainability goals. As such, there may be an opportunity for vendors to enhance customer education about the benefits of PEI ratings, potentially leading to more informed choices and increased demand for energy-efficient pump options.

Common Pumps in the Market

Pump Size

The survey explored the most commonly-sold pump sizes among the pool of pump manufacturers and vendors who participated. The majority of participants indicated that pumps in the 15 to 50 HP8 range are the most frequently sold, with five out of eight participants selecting this category, as illustrated in Figure 6 below.

⁸ While most pump vendors surveyed offer a range of pump sizes, only the most common sizes are included in this study.



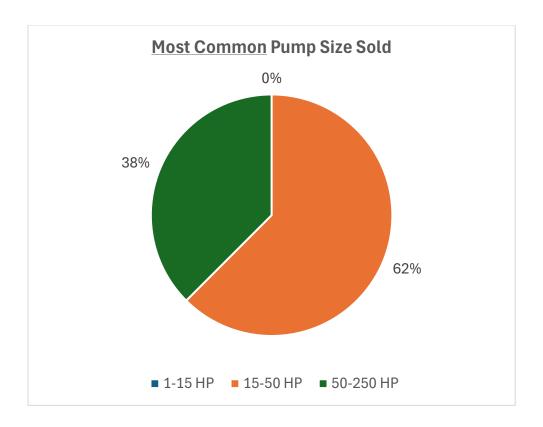


Figure 6: Most common pump size sold

Common Pump PEI Rating

The survey sought to determine the most common PEI ratings observed by participants. Manufacturers and vendors were asked to provide the top three most common pump models sold, enabling the PEI ratings to be looked up or calculated using the Hydraulic Institute (HI) Energy Ratings database if the participants were not familiar with the ratings themselves.

While some manufacturers and vendors expressed willingness to share the most common pump models at a later date, they were unable to share that information with the project team. Also, the majority of participants were unaware of the typical PEI ratings for pumps sold.

One participant was able to provide PEI ratings for commonly sold pumps, which are detailed in Table 6 below. This participant was from Northwest Energy Efficiency Alliance (NEEA) and provided the PEI ratings, based on a database of sales data collected from firms selling pumps in the Northwest. This data is not shareable, as it is protected by various non-disclosure agreements (NDAs), and so has not been validated by the project team. Later on, this same participant provided some public-facing documents that could validate the PEI ratings in Table 6. This data is discussed in a later section.



Table 6: Common PEI Ratings

| Pump Size | Constant Speed Pumps | Variable Speed Pumps |
|-----------|----------------------|----------------------|
| 1-15 HP | 0.90-0.93 | 0.48-0.50 |
| 15-50 HP | 0.94-0.98 | 0.48-0.50 |
| 50-250 HP | - | - |

Number of Pumps Sold

The survey addressed the number of pumps sold within each pump size category. While no actual sales data were shared during the survey, it was estimated through ranges of tens, hundreds, or thousands of pumps sold annually over the previous three years. It was noted that the pumps within the 1 to 15 HP and 15 to 50 HP ranges were predominantly sold in the thousands across multiple pump manufacturers and vendors. The 50 to 250 HP sized pumps were sold in the hundreds, as shown in Figure 7.

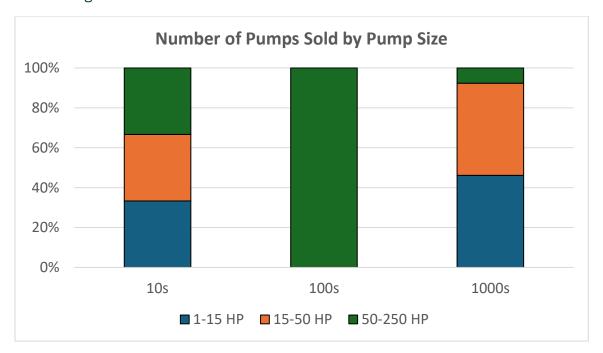


Figure 7: Number of pumps sold by pump size

These findings indicate that small- to medium-sized pumps (1 to 15 HP) and (15 to 50 HP) have a significantly larger market presence, likely due to their versatility and applicability across a wide range of industries and applications. The lower sales figures for larger pumps (50 to 250 HP) suggest a more specialized market, where demand may be influenced by specific industrial requirements or project-based needs.

Availability of Efficient Pumps

When asked about the availability and accessibility of energy-efficient pumps, the majority of survey participants agreed that such pumps are readily available. One respondent mentioned that although



there were supply chain issues during the pandemic, the process of acquiring efficient pumps has significantly improved in recent years. Figure 8 below illustrates the current availability of energy-efficient pumps in the market.

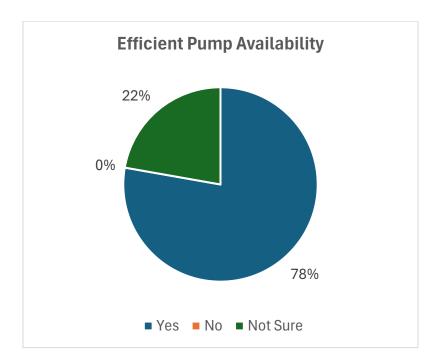


Figure 8: Availability of efficient pumps

Market Data

The project team received a summary of sales data from six pump manufacturers in the Northwest region from the 2021 and 2022 period (Northwest Energy Efficiency Alliance (NEEA) 2023). This data, collected from distributors participating in NEEA's Extended Motor Products (XMP) program, includes average PEIs for all pumps sold by these manufacturers. The project team could not find publicly-available data from 2023 or 2024 from the XMP program. The data is categorized by pump types and maximum pump speed for constant speed pumps. The following manufacturers' sales data was included in the database:

- Armstrong
- Bell & Gosset Xylem
- Goulds Water Technology Xylem
- Grundfos
- PACO
- Taco

NEEA provided the Northwest Regional Technical Forum (RTF) with this public-facing sales data in a spreadsheet, where the data was aggregated and anonymized. Table 7 summarizes the PEIs by



pump type, size, and control method. NEEA estimates that the pump sales data collected through the XMP program represents 70 percent of the clean water pumping market in the region. If a cell in Table 7 indicates "insufficient data," it means there was either not enough sales data to anonymize it or no data available for that particular pump type and speed combination.

Table 7: XMP Sales Data Provided to RTF

| Pump Type | Control | Pump Speed (RPM) | 1 to 9.9 HP | 10 to 49.9 HP | 50 to 200 HP | Market Average |
|--|-------------------|------------------------|----------------------|----------------------|----------------------|----------------------|
| End Suction Close Coupled (ESCC) | Constant Speed | 1800 | 0.89 | 0.95 | insufficient data | 0.91 |
| End Suction Close Coupled (ESCC) | Constant Speed | 3600 | 0.93 | 0.9 | insufficient data | 0.93 |
| End Suction Frame Mounted (ESFM) | Constant Speed | 1800 | 0.88 | 0.92 | 0.94 | 0.9 |
| End Suction Frame Mounted (ESFM) | Constant Speed | 3600 | 0.92 | insufficient data | insufficient data | 0.91 |
| In-Line (IL) | Constant Speed | 1800 | 0.9 | 0.94 | insufficient data | 0.91 |
| In-Line (IL) | Constant Speed | 3600 | insufficient data | 0.89 | insufficient data | insufficient data |
| Radially split, multi-stage, vertical, in-line casing diffuser (RSV) | Constant Speed | 1800 | insufficient data | insufficient data | insufficient data | 0.92 |
| Radially split, multi-stage, vertical, in-line casing diffuser (RSV) | Constant Speed | 3600 | 0.92 | 0.91 | insufficient data | 0.92 |



Incorporating the NEEA data into the standard practice baseline for measure package SWWP004 presents several challenges. The first challenge is that the NEEA data is categorized into different horsepower bins than those used in SWWP004, as shown in Table 8 below.

Table 8: XMP Sales Data vs. SWWP005 HP Bins

| XMP Bin | SWWP004 Bin |
|-------------------|-------------|
| 1-9.9 HP | 1-14.9 HP |
| 10-49.9 HP | 15-49.9 HP |
| 50-200 HP | 50-249.9 HP |

The second challenge is that the sales data is categorized by pump type (ESCC, ESFM, IL, RSV) and pump speed, while the bins in SWWP004 are categorized only by horsepower. The sales data does include the PEI weightage for each pump type, so calculating a simple average PEI of all pumps by horsepower may not accurately reflect the market.

The third challenge is that the sales data only covers constant speed clean water pumps. It does not include data for variable speed and wastewater pumps. Additionally, there is not sufficient data for pumps above 50 HP, except for ESFM pumps operating at 1800 RPM.

The fourth challenge is that the 70 percent market share estimate remains unvalidated. NEEA conducted a study in 2022 to verify the estimate, but the results were inconclusive (Albers 2022). Moreover, the 70 percent market share of these six manufacturers in the Northwest does not necessarily imply the same market share in California, adding another layer of uncertainty.

The final and perhaps most critical challenge is that the sales data collected through the XMP program may be skewed toward more efficient pumps, as data is limited to manufacturers who participate in the XMP program.

To determine if specific manufacturers would skew PEI data, the project team counted the total number of pumps from each pump manufacturer listed in the DOE Pump Compliance Certification database which was included in the spreadsheet file provided to RTF. The total number of pumps for the six participating manufacturers are shown in Table 9 below, and Figure 9 shows a histogram of the total number of pumps in the DOE Pump Compliance Certification Database by manufacturer with the six participating manufacturers called out.

Table 9: Number of Pumps in DOE Pump Compliance Certification Database

| Manufacturer | Total Number of Pumps |
|---------------------------------|-----------------------|
| Armstrong | 1280 |
| Bell & Gosset - Xylem | 852 |
| Goulds Water Technology – Xylem | 966 |
| Grundfos | 2015 |
| PACO | 0 |
| Taco | 502 |



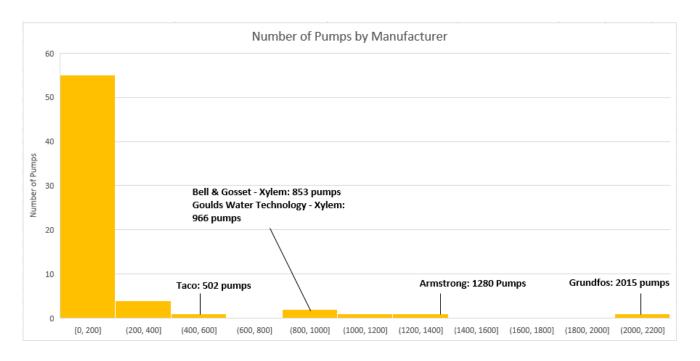


Figure 9: Number of pumps in DOE Compliance Certification Database by manufacturer

Most pump manufacturers in the DOE Pump Compliance Database have less than 650 pumps listed. Three of the six participating manufacturers have more pumps than other manufacturers. If the average PEI of the six participating manufacturers is lower than that of the non-participating manufacturers (meaning their pumps are more efficient), the XMP sales data could be skewed toward a more efficient PEI value. Table 10 shows the comparison between the average PEI data for participating and the non-participating manufacturers.

Table 10: Comparison of Average PEIs for Participating and Non-Participating Pump Manufacturers

| Motor Size | Pump Category | Avg PEI: Non- Participating Manufacturers | Avg PEI: Participating Manufacturers | Participating Manufacturer More Efficient Than Non- Participating? [Y/N] |
|----------------------|------------------|---|--|--|
| 1 to 9.9 HP | ESCC 1800 | 0.90 | 0.91 | Υ |
| 1 to 9.9 HP | ESCC 3600 | 0.82 | 0.89 | N |
| 1 to 9.9 HP | ESFM 1800 | 0.93 | 0.92 | Υ |
| 1 to 9.9 HP | ESFM 3600 | 0.95 | 0.89 | N |
| 1 to 9.9 HP | IL 1800 | 0.95 | 0.92 | Υ |
| 1 to 9.9 HP | RSV 3600 | 0.93 | 0.92 | N |
| 10 to 49.9 HP | ESCC 1800 | 0.93 | 0.93 | N |
| 10 to 49.9 HP | ESCC 3600 | 0.95 | 0.91 | Υ |
| 10 to 49.9 HP | ESFM 1800 | 0.94 | 0.93 | N |
| 10 to 49.9 HP | IL 1800 | 0.97 | 0.95 | N |
| 10 to 49.9 HP | IL 3600 | 0.96 | 0.91 | Υ |



| Motor Size | Pump Category | Avg PEI: Non- Participating Manufacturers | Avg PEI: Participating Manufacturers | Participating Manufacturer More Efficient Than Non- Participating? [Y/N] |
|----------------------|------------------|---|--|--|
| 10 to 49.9 HP | RSV 3600 | 0.96 | 0.92 | Υ |
| 50 to 200 HP | ESFM 1800 | 0.96 | 0.96 | Υ |

Error! Reference source not found. shows that half of the time the average PEI rating of the participating manufacturers is more efficient than that of the non-participating manufacturers. Therefore, these results do not show that the XMP sales data is skewed toward higher PEIs.

The project team also determined at what percentile the XMP sales data PEIs landed, based on the DOE Pump Compliance Database. The results are summarized in Table 11 and Figure 10. In Error! Reference source not found., the average PEI from the XMP sales data for an ESCC pump at 1800 RPM is 0.89, which lies at the 67th percentile of all pumps from the DOE Compliance Certification Database that are ESCC and 1800 RPM. This means that only 27 percent of all pumps of that type and speed in the DOE Pump Compliance Certification Database are more efficient than the XMP sales data average PEI.

Table 11: XMP Sales Data Percentiles

| Motor Size | Pump Category | XMP Sales Data PEI | Percentile |
|---------------|---------------|--------------------|------------|
| 1 to 9.9 HP | ESCC 1800 | 0.89 | 67th |
| 1 to 9.9 HP | ESCC 3600 | 0.93 | 49th |
| 1 to 9.9 HP | ESFM 1800 | 0.88 | 88th |
| 1 to 9.9 HP | ESFM 3600 | 0.92 | 92nd |
| 1 to 9.9 HP | IL 1800 | 0.90 | 84th |
| 1 to 9.9 HP | RSV 3600 | 0.92 | 50th |
| 10 to 49.9 HP | ESCC 1800 | 0.95 | 61st |
| 10 to 49.9 HP | ESCC 3600 | 0.90 | 78th |
| 10 to 49.9 HP | ESFM 1800 | 0.92 | 87th |
| 10 to 49.9 HP | IL 1800 | 0.94 | 85th |
| 10 to 49.9 HP | IL 3600 | 0.89 | 81st |
| 10 to 49.9 HP | RSV 3600 | 0.91 | 88th |
| 50 to 200 HP | ESFM 1800 | 0.94 | 76th |
| Average | | | 76th |



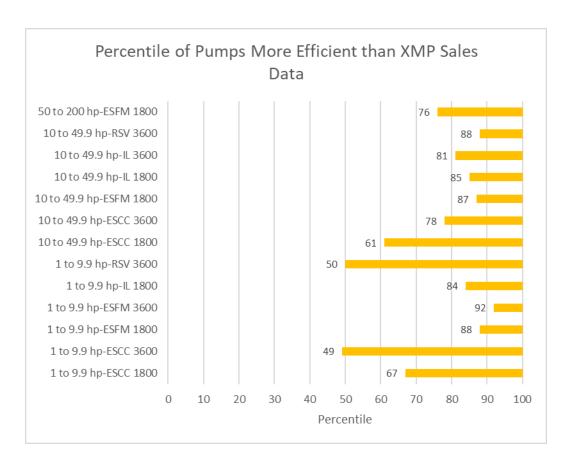


Figure 10: XMP sales data percentiles

The average PEIs from the XMP sales data fell between the 49th and 92nd percentile of pumps in the DOE Compliance Certification Database, with an average at the 76th percentile. In other words, only about 25 percent of all pumps (for which there was sufficient XMP sales data) are more efficient than those sold by participating manufacturers in the XMP program. This suggests that the XMP sales data reflects the program's influence on shifting the pumping market toward more efficient pumps. Consequently, this data is not a reliable indicator of ISP in the absence of an incentive program and in other markets.

Hydraulic Institute Pump Database vs. DOE Compliance Certification Database

The program team also reviewed the HI's pump database. Likewise, the program team noted that NEEA's XMP program used the DOE Compliance Certification Database⁹ for insufficient data. Upon further investigation, the requirements for 10 CFR 431.464, 10 CFR 431.465, and 10 CFR 431 Subpart Y do not require third-party testing or certification.

A major differentiation between the HI Energy Rating Database and complying with DOE's database is that HI requires third-party certification of the testing. The HI program requires laboratories to be

9 CCMS - Public Database (doe.gov)



approved through their Pump Test Laboratory Approval Program. While comparing the datasets of both databases, it was clear there is overlap between both datasets and each dataset has pump technology that is unique to each dataset.

Both datasets required some cleaning because they had erroneous records. The following records were cleaned out of both datasets:

- PEI if it was <0.2 or >0.95
- PEI if it was >0.4 for a constant load pump and >0.2 for a variable load pump
- Bowl diameter if it was >6 inches for a submersible turbine pump¹⁰
- gpm if it was <25¹¹
- Head if it was >459 Feet¹²
- Specific speed >5,000¹³

The project team had to remove 297 records from the DOE database (three percent of the records) and 279 records from the HI database (two percent of the records). Once the databases were cleaned up by removing erroneous records, the 25th percentile PEI was calculated for each pump horsepower range and control type.

The existing baseline PEI values in SWWP004 were determined using the average PEI from a database of performance data collected from major manufacturers and the HI (California Energy Efficiency Measure Data 2023). The CPUC directed that the measure package should use the most commonly available PEI (mode) in the dataset for each control strategy and pump size range. The existing baseline PEI values in SWWP004 and the 25th percentiles of the DOE Compliance Certification database and HI database using this analysis are shown in

¹³ DOE standards do not apply to pumps with specific speed that is greater than 5,000.



¹⁰ DOE standards do not apply to submersible turbine pumps with bowl diameters greater than six inches.

¹¹ DOE standards do not apply to pumps with flow less than 25 gpm.

¹² DOE standards do not apply to pumps with head greater than 459 feet.

Table 12 below.



Table 12: Comparison of PEI values

| Pump Size | Control Strategy | SWWP004 Baseline PEI | DOE Compliance Certification Database PEI | Hydraulic Institute Database PEI |
|---------------|------------------|----------------------|---|--|
| 1 to 14.9 HP | Variable Speed | 0.47 | 0.62 | 0.50 |
| | Constant Speed | 0.94 | 0.97 | 0.96 |
| 15 to 49.9 HP | Variable Speed | 0.49 | 0.52 | 0.49 |
| | Constant Speed | 0.94 | 0.97 | 0.97 |
| 50 to 250 HP | Variable Speed | 0.49 | 0.51 | 0.57 |
| | Constant Speed | 0.95 | 0.97 | 0.98 |

The baseline PEI values between the DOE Compliance Certification Database and the HI Energy Rating Database are similar for constant speed pumps, but there is more of a difference among the variable speed pump permutations. The project team recommends that the baseline PEI in SWWP004 be based upon the 25th percentile of the most up-to-date DOE Compliance Certification Database to better align with the findings of the ISP surveys.

ISP Findings

By and large, end-use customers are not aware of PEI ratings, and vendors do not use PEI ratings to sell pumps to them. When vendors talk to customers about pump efficiency, they do not use the term PEI. Survey results also indicate that customers consider pump efficiency as a secondary criteria to make pump purchasing decisions after reliability and initial cost.

Participants indicated that "efficient" pumps are readily available for purchase but could not provide PEI ratings of "efficient" pumps, with the exception of a single participant. The single participant who could provide PEI ratings of efficient pumps was from NEEA, and provided this information based on market data collected by NEEA. This market data shows the influence of NEEAs XMP program to move the market toward efficient pumps, and it is not a good indicator of what would happen absent incentive programs.

1 to 50 HP pumps have more market share than 50 to 250 HP pumps, but since no PEI ratings were given for different pump sizes with the exception of the NEEA participant, the project team cannot use the survey data alone to determine if ISP PEI is different for various pump sizes.

Survey participants indicated differences between clean water and wastewater pumps, but none of the differences would affect the rated PEI of pumps sold into each sector.

The project team recommends that the baseline PEI in SWWP004 be based upon the most up-to-date DOE Compliance Certification Database, and that the baseline PEI be set at the 25th percentile



in each pump size range and control strategy combination. The 25th percentile strikes a balance between the survey results, which show that customers are not aware of PEI and value efficiency after reliability and cost. Further, DOE's 1.0 minimum PEI represents the extreme end of the dataset and most pumps are more efficient than this minimum.

This recommendation will go into the draft ISP study that will be reviewed by SCE's measure package team and may be reviewed by the CPUC at their discretion. If the CPUC or SCE's measure package team have additional data that is recommended to be included, the project team will respond to those recommendations and update the ISP study.

Measure Package Update

As advised by the CPUC, measure package development for SWWP004 Water Pump Upgrade is being updated for 2025 without incorporating the baseline PEI findings of the market-based ISP study. This is to prevent a gap in the measure offering while the ISP study wraps up. However, the updated measure package does include addition of wastewater pumps based on the findings from the Wastewater Pump Measure Development Study (ET23SWE0039) and a cost update to reflect 2024 costs for pump replacement.

The following sections come from the "Measure Characterization" eTRM. The draft measure package is complete and will require reviews by SCE, the California Technical Forum (Cal TF), and the CPUC to be finalized.

Technology Summary

The U.S. Department of Energy (DOE) defines a "pump" as equipment used to move liquids (which may contain entrained gases, free solids, and totally dissolved solids) by physical or mechanical action. A pump includes a bare pump and mechanical equipment, driver, and controls.

Water pumps are the second most commonly-sought equipment after the motor and are found across all sectors. In addition, nearly one-fifth of electricity generated in California supports water-related uses.

In California, over 900 wastewater treatment plants (WWTPs) manage approximately four billion gallons of wastewater daily. It is estimated that up to 19 percent of the state's total electricity consumption is dedicated to the pumping, treatment, collection, and discharge of water and wastewater, which can constitute 30 to 40 percent of a municipality's energy expenses (Copeland). Specifically, pumping operations in wastewater facilities account for roughly 14.8 percent of a typical site's energy use, including wastewater pumping and return sludge pumping. Depending on the plant's design, various pumps are used in the treatment process. These pumps include process influent pumps, return activated sludge (RAS) pumps, waste activated sludge (WAS) pumps, sump pumps, and collection system conveyance pumps, all of which handle materials ranging from raw wastewater to thickened sludge. The most common types of pumps include centrifugal, progressive cavity, and positive displacement pumps. The WWTP site's terrain and the influent sanitary sewer depth determine the need for and placement of pumping applications, ensuring continuous and costeffective treatment through the plant's unit processes.



To standardize pump efficiency requirements and move the market towards minimally efficient pumps, DOE developed the Energy Conservation Standard (ECS) for commercial, industrial, and agricultural clean water pumps. The HI and DOE developed the pump energy efficiency rating system, PEI, to achieve this goal. The PEI is the weighted average performance of the rated pump at specific load points and normalized with respect to the performance of a minimally compliant pump. Since 2016, pumps have been sold with ECS labels that include PEI.

Per the HI Program Guide, "the constant-load pump will not vary the speed and the system head will vary to achieve the variable flow points and the variable-load pump will vary the speed to achieve the variable flow points." Therefore, this measure package uses "load" and "speed" interchangeably, such as constant load and constant speed.

The California utility customers funded one Emerging Technologies (ET) Program study to develop the necessary data for creating a deemed measure offering for the replacement of wastewater pumps, for eventual application within the statewide program, as indicated in Table 13 below.

Table 13: Emerging Technologies Study

| Project Number | Program Funding Year | Year Introduced to Programs |
|----------------|----------------------|-----------------------------|
| ET23SWE0039 | 2023 | N/A |

Measure Case Description

This measure is defined as the installation of a clean water pump or wastewater pump with PEI as specified below. The measure case PEI tiers were set by incrementally improving the PEIs by values of 0.02 for each tier. These efficiency tiers were selected based on a review of the PEI distribution of eligible pumps in the HI pump database. Note that only two tiers were approved for the largest horsepower variable speed bin because no products currently exist in the highest PEI bin for that size and control combination. As shown, measure offerings (and therefore measure impacts) vary by load type (variable or constant) and by pump motor horsepower range.



Table 14: Measure Case Description

| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Measure Offering Description (text) |
|--------------------------|----------------------|---------------------|---------------------|---|--|
| 1 ≤ HP ≤ 15 | PEI ≤ 0.41 | Clean water | Variable Speed | R | Clean water pump, PEI \leq 0.41, variable speed, $1 \leq$ HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.41 | Wastewater | Variable Speed | AA | Wastewater pump, PEI \leq 0.41, variable speed, $1 \leq$ HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.43 | Clean water | Variable Speed | Q | Clean water pump, PEI \leq 0.43, variable speed, $1 \leq$ HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.43 | Wastewater | Variable Speed | АВ | Wastewater pump, PEI \leq 0.43, variable speed, $1 \leq$ HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.45 | Clean water | Variable Speed | Р | Clean water pump, PEI \leq 0.45, variable speed, $1 \leq$ HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.45 | Wastewater | Variable Speed | AC | Wastewater pump, PEI \leq 0.45, variable speed, $1 \leq$ HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.88 | Clean water | Constant Speed | I | Clean water pump, PEI \leq 0.88, constant speed, $1 \leq$ HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.88 | Wastewater | Constant Speed | AD | Wastewater pump, PEI \leq 0.88, constant speed, 1 < HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.90 | Clean water | Constant Speed | Н | Clean water pump, PEI \leq 0.90, constant speed, $1 \leq$ HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.90 | Wastewater | Constant Speed | AE | Wastewater pump, PEI \leq 0.90, constant speed, 1 < HP \leq 15 |
| 1 ≤ HP ≤ 15 | PEI ≤ 0.92 | Clean water | Constant Speed | G | Clean water pump, PEI \leq 0.92, constant speed, $1 \leq$ HP \leq 15 |



| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Measure Offering Description (text) |
|--------------------------|----------------------|---------------------|---------------------|---|--|
| 1 ≤ HP ≤ 15 | PEI ≤ 0.92 | Wastewater | Constant Speed | AF | Wastewater pump, PEI \leq 0.92, constant speed, 1 < HP \leq 15 |
| 15 < HP ≤ 50 | PEI ≤ 0.43 | Clean water | Variable Speed | U | Clean water pump, PEI \leq 0.43, variable speed, 15 < HP \leq 50 |
| 15 < HP ≤ 50 | PEI ≤ 0.43 | Wastewater | Variable Speed | AG | Wastewater pump, PEI \leq 0.43, variable speed, 15 < HP \leq 50 |
| 15 < HP ≤ 50 | PEI ≤ 0.45 | Clean water | Variable Speed | Т | Clean water pump, PEI \leq 0.45, variable speed, 15 < HP \leq 50 |
| 15 < HP ≤ 50 | PEI ≤ 0.45 | Wastewater | Variable Speed | АН | Wastewater pump, PEI \leq 0.45, variable speed, 15 < HP \leq 50 |
| 15 < HP ≤ 50 | PEI ≤ 0.47 | Clean water | Variable Speed | S | Clean water pump, PEI \leq 0.47, variable speed, 15 < HP \leq 50 |
| 15 < HP ≤ 50 | PEI ≤ 0.47 | Wastewater | Variable Speed | Al | Wastewater pump, PEI \leq 0.47, variable speed, 15 < HP \leq 50 |
| 15 < HP≤ 50 | PEI ≤ 0.88 | Clean water | Constant Speed | L | Clean water pump, PEI \leq 0.88, constant speed, 15 < HP \leq 50 |
| 15 < HP ≤ 50 | PEI ≤ 0.88 | Wastewater | Constant Speed | AJ | Wastewater pump, PEI \leq 0.88, constant speed, 15 < HP \leq 50 |
| 15 < HP ≤ 50 | PEI ≤ 0.90 | Clean water | Constant Speed | К | Clean water pump, PEI \leq 0.90, constant speed, 15 < HP \leq 50 |
| 1 5 < HP ≤ 50 | PEI ≤ 0.90 | Wastewater | Constant Speed | AK | Wastewater pump, PEI \leq 0.90, constant speed, 15 < HP \leq 50 |



| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Measure Offering Description (text) |
|--------------------------|----------------------|---------------------|---------------------|---|---|
| 15 < HP ≤ 50 | PEI ≤ 0.92 | Clean water | Constant Speed | J | Clean water pump, PEI \leq 0.92, constant speed, 15 < HP \leq 50 |
| 15 < HP ≤ 50 | PEI ≤ 0.92 | Wastewater | Constant Speed | AL | Wastewater pump, PEI \leq 0.92, constant speed, 15 < HP \leq 50 |
| 50 < HP ≤ 250 | PEI ≤ 0.45 | Clean water | Variable Speed | W | Clean water pump, PEI \leq 0.45, variable speed, 50 < HP \leq 250 |
| 50 < HP ≤ 250 | PEI ≤ 0.45 | Wastewater | Variable Speed | AM | Wastewater pump, PEI \leq 0.45, variable speed, 50 < HP \leq 250 |
| 50 < HP ≤ 250 | PEI ≤ 0.47 | Clean water | Variable Speed | V | Clean water pump, PEI \leq 0.47, variable speed, 50 < HP \leq 250 |
| 50 < HP ≤ 250 | PEI ≤ 0.47 | Wastewater | Variable Speed | AN | Wastewater pump, PEI \leq 0.47, variable speed, 50 < HP \leq 250 |
| 50 < HP ≤ 250 | PEI ≤ 0.89 | Clean water | Constant Speed | 0 | Clean water pump, PEI \leq 0.89, constant speed, 50 < HP \leq 250 |
| 50 < HP ≤ 250 | PEI ≤ 0.89 | Wastewater | Constant Speed | AO | Wastewater pump, PEI \leq 0.89, constant speed, 50 < HP \leq 250 |
| 50 < HP ≤ 250 | PEI ≤ 0.91 | Clean water | Constant Speed | N | Clean water pump, PEI \leq 0.91, constant speed, 50 < HP \leq 250 |
| 50 < HP ≤ 250 | PEI ≤ 0.91 | Wastewater | Constant Speed | АР | Wastewater pump, PEI \leq 0.91, constant speed, 50 < HP \leq 250 |
| 50 < HP ≤ 250 | PEI ≤ 0.93 | Clean water | Constant Speed | M | Clean water pump, PEI \leq 0.93, constant speed, 50 < HP \leq 250 |



| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Measure Offering Description (text) |
|--------------------------|----------------------|---------------------|---------------------|---|---|
| 50 < HP ≤ 250 | PEI ≤ 0.93 | Wastewater | Constant Speed | AQ | Wastewater pump, PEI ≤ 0.93, constant speed, 50 < HP≤ 250 |

Base Case Description

The base case for this measure is a clean water pump or wastewater pump with a PEI rating specified below. These baseline values were calculated from a database of performance data collected from major manufacturers and the HI. Per direction from the CPUC, the baseline PEI ratings are representative of the most commonly available (mode) of the dataset for each control strategy and pump motor horsepower range. Note that the federal standard requires a clean water pump system to have a PEI rating \leq 1.0 (see <u>Code Requirements</u> section).

Table 15: Base Case Description

| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Existing Description (text) | Standard Description (text) |
|--------------------------|-------------------------|---------------------|---------------------|---|--|---|
| 1 ≤ HP ≤ 15 | ≤ 0.41 | Clean water | Variable Speed | R | Standard clean water pump, PEI 0.47, variable speed, $1 \le HP \le 15$ | Standard clean water pump, PEI 0.47, variable speed, $1 \le HP \le 15$ |
| 1 ≤ HP ≤ 15 | ≤ 0.41 | Wastewater | Variable Speed | AA | Standard wastewater pump, PEI 0.47, variable speed, $1 \le HP \le 15$ | Standard wastewater pump, PEI 0.47, variable speed, 1 ≤ HP ≤ 15 |
| 1 ≤ HP ≤ 15 | ≤ 0.43 | Clean water | Variable Speed | Q | Standard clean water pump, PEI 0.47, variable speed, $1 \le HP \le 15$ | Standard clean water pump, PEI 0.47, variable speed, $1 \le HP \le 15$ |



| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Existing Description (text) | Standard Description (text) |
|--------------------------|-------------------------|---------------------|---------------------|---|--|--|
| 1 ≤ HP ≤ 15 | ≤ 0.43 | Wastewater | Variable Speed | AB | Standard wastewater pump, PEI 0.47, variable speed, $1 \le HP \le 15$ | Standard wastewater pump, PEI 0.47, variable speed, $1 \le HP \le 15$ |
| 1 ≤ HP ≤ 15 | ≤ 0.45 | Clean water | Variable Speed | Р | Standard clean water pump, PEI 0.47, variable speed, $1 \le HP \le 15$ | Standard clean water pump, PEI 0.47, variable speed, $1 \le HP \le 15$ |
| 1 ≤ HP ≤ 15 | ≤ 0.45 | Wastewater | Variable Speed | AC | Standard wastewater pump, PEI 0.47, variable speed, $1 \le HP \le 15$ | Standard wastewater pump, PEI 0.47, variable speed, $1 \le HP \le 15$ |
| 1 ≤ HP ≤ 15 | ≤ 0.88 | Clean water | Constant Speed | I | Standard clean water pump, PEI 0.94, constant speed, $1 \le HP \le 15$ | Standard clean water pump, PEI 0.94, constant speed, $1 \le HP \le 15$ |
| 1 ≤ HP ≤ 15 | ≤ 0.88 | Wastewater | Constant Speed | AD | Standard wastewater pump, PEI 0.94, constant speed, $1 \le HP \le 15$ | Standard wastewater pump, PEI 0.94, constant speed, $1 \le HP \le 15$ |
| 1 ≤ HP≤ 15 | ≤ 0.90 | Clean water | Constant Speed | Н | Standard clean water pump, PEI 0.94, constant speed, $1 \le HP \le 15$ | Standard clean water pump, PEI 0.94, constant speed, $1 \le HP \le 15$ |
| 1 ≤ HP ≤ 15 | ≤ 0.90 | Wastewater | Constant Speed | AE | Standard wastewater pump, PEI 0.94, constant speed, $1 \le HP \le 15$ | Standard wastewater pump, PEI 0.94, constant speed, $1 \le HP \le 15$ |



| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Existing Description (text) | Standard Description (text) |
|--------------------------|-------------------------|---------------------|---------------------|---|---|---|
| 1 ≤ HP ≤ 15 | ≤ 0.92 | Clean water | Constant Speed | G | Standard clean water pump, PEI 0.94, constant speed, $1 \le HP \le 15$ | Standard clean water pump, PEI 0.94, constant speed, $1 \le HP \le 15$ |
| 1 ≤ HP ≤ 15 | ≤ 0.92 | Wastewater | Constant Speed | AF | Standard wastewater pump, PEI 0.94, constant speed, $1 \le HP \le 15$ | Standard wastewater pump, PEI 0.94, constant speed, $1 \le HP \le 15$ |
| 15 < HP ≤ 50 | ≤ 0.43 | Clean water | Variable Speed | U | Standard clean water pump, PEI 0.49, variable speed, 15 < HP ≤ 50 | Standard clean water pump, PEI 0.49, variable speed, 15 < HP ≤ 50 |
| 15 < HP ≤ 50 | ≤ 0.43 | Wastewater | Variable Speed | AG | Standard wastewater pump, PEI 0.49, variable speed, $15 \le HP \le 50$ | Standard wastewater pump, PEI 0.49, variable speed, $15 \le HP \le 50$ |
| 15 < HP ≤ 50 | ≤ 0.45 | Clean water | Variable Speed | Т | Standard clean water pump, PEI 0.49, variable speed, 15 < HP ≤ 50 | Standard clean water pump, PEI 0.49, variable speed, 15 < HP ≤ 50 |
| 15 < HP ≤ 50 | ≤ 0.45 | Wastewater | Variable Speed | АН | Standard wastewater pump, PEI 0.49, variable speed, $15 \le HP \le 50$ | Standard wastewater pump, PEI 0.49, variable speed, $15 \le HP \le 50$ |
| 15 < HP ≤ 50 | ≤ 0.47 | Clean water | Variable Speed | S | Standard clean water pump, PEI 0.49, variable speed, 15 < HP ≤ 50 | Standard clean water pump, PEI 0.49, variable speed, 15 < HP ≤ 50 |



| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Existing Description (text) | Standard Description (text) |
|--------------------------|-------------------------|---------------------|---------------------|---|--|---|
| 1 5 < HP ≤ 50 | ≤ 0.47 | Wastewater | Variable Speed | Al | Standard wastewater pump, PEI 0.49, variable speed, $15 \le HP \le 50$ | Standard wastewater pump, PEI 0.49, variable speed, $15 \le HP \le 50$ |
| 1 5 < HP ≤ 50 | ≤ 0.88 | Clean water | Constant Speed | L | Standard clean water pump, PEI 0.94, constant speed, 15 < HP ≤ 50 | Standard clean water pump, PEI 0.94, constant speed, 15 < HP ≤ 50 |
| 1 5 < HP ≤ 50 | ≤ 0.88 | Wastewater | Constant Speed | AJ | Standard wastewater pump, PEI 0.94, constant speed, $15 \le HP \le 50$ | Standard wastewater pump, PEI 0.94, constant speed, $15 \le HP \le 50$ |
| 1 5 < HP ≤ 50 | ≤ 0.90 | Clean water | Constant Speed | К | Standard clean water pump, PEI 0.94, constant speed, 15 < HP ≤ 50 | Standard clean water pump, PEI 0.94, constant speed, 15 < HP ≤ 50 |
| 1 5 < HP ≤ 50 | ≤ 0.90 | Wastewater | Constant Speed | AK | Standard wastewater pump, PEI 0.94, constant speed, $15 \le HP \le 50$ | Standard wastewater pump, PEI 0.94, constant speed, $15 \le HP \le 50$ |
| 1 5 < HP ≤ 50 | ≤ 0.92 | Clean water | Constant Speed | J | Standard clean water pump, PEI 0.94, constant speed, 15 < HP ≤ 50 | Standard clean water pump, PEI 0.94, constant speed, 15 < HP ≤ 50 |
| 1 5 < HP ≤ 50 | ≤ 0.92 | Wastewater | Constant Speed | AL | Standard wastewater pump, PEI 0.94, constant speed, $15 \le HP \le 50$ | Standard wastewater pump, PEI 0.94, constant speed, $15 \le HP \le 50$ |



43

| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Existing Description (text) | Standard Description (text) |
|--------------------------|-------------------------|---------------------|---------------------|---|---|--|
| 50 < HP ≤ 250 | ≤ 0.45 | Clean water | Variable Speed | W | Standard clean water pump, PEI 0.49, variable speed, 50 < HP≤ 250 | Standard clean water pump, PEI 0.49, variable speed, 50 < HP≤ 250 |
| 50 < HP ≤ 250 | ≤ 0.45 | Wastewater | Variable Speed | AM | Standard wastewater pump, PEI 0.49, variable speed, $50 \le HP \le 250$ | Standard wastewater pump, PEI 0.49, variable speed, $50 \le HP \le 250$ |
| 50 < HP ≤ 250 | ≤ 0.47 | Clean water | Variable Speed | V | Standard clean water pump, PEI 0.49, variable speed, 50 < HP ≤ 250 | Standard clean water pump, PEI 0.49, variable speed, 50 < HP ≤ 250 |
| 50 < HP ≤ 250 | ≤ 0.47 | Wastewater | Variable Speed | AN | Standard wastewater pump, PEI 0.49, variable speed, $50 \le HP \le 250$ | Standard wastewater pump, PEI 0.49, variable speed, $50 \le HP \le 250$ |
| 50 < HP ≤ 250 | ≤ 0.89 | Clean water | Constant Speed | 0 | Standard clean water pump, PEI 0.95, constant speed, 50 < HP ≤ 250 | Standard clean water pump, PEI 0.95, constant speed, 50 < HP ≤ 250 |
| 50 < HP ≤ 250 | ≤ 0.89 | Wastewater | Constant Speed | AO | Standard wastewater pump, PEI 0.95, constant speed, $50 \le HP \le 250$ | Standard wastewater pump, PEI 0.95, constant speed, $50 \le HP \le 250$ |
| 50 < HP ≤ 250 | ≤0.91 | Clean water | Constant Speed | N | Standard clean water pump, PEI 0.95, constant speed, 50 < HP ≤ 250 | Standard clean water pump, PEI 0.95, constant speed, 50 < HP ≤ 250 |



| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | Statewide Measure Offering ID (text) | Existing Description (text) | Standard Description (text) |
|--------------------------|-------------------------|---------------------|---------------------|---|---|--|
| 50 < HP ≤ 250 | ≤ 0.91 | Wastewater | Constant Speed | АР | Standard wastewater pump, PEI 0.95, constant speed, $50 \le HP \le 250$ | Standard wastewater pump, PEI 0.95, constant speed, $50 \le HP \le 250$ |
| 50 < HP ≤ 250 | ≤ 0.93 | Clean water | Constant Speed | M | Standard clean water pump, PEI 0.95, constant speed, 50 < HP ≤ 250 | Standard clean water pump, PEI 0.95, constant speed, 50 < HP ≤ 250 |
| 50 < HP ≤ 250 | ≤ 0.93 | Wastewater | Constant Speed | AQ | Standard wastewater pump, PEI 0.95, constant speed, $50 \le HP \le 250$ | Standard wastewater pump, PEI 0.95, constant speed, $50 \le HP \le 250$ |

Code Requirements

This measure is not governed by California state codes and standards. Under Title 10 Section 431.462, the U.S. Department of Energy (DOE) developed the Energy Conservation Standard (ECS) for commercial, industrial, and agricultural clean water pumps. As of January 2020, all clean water pumps sold are required to have an ECS label with a PEI rating \leq 1.0.

Table 16: Applicable State and Federal Codes and Standards

| Code | Applicable Code Reference | Effective Date |
|---|---------------------------|------------------|
| CA Appliance Efficiency Regulations – Title 20 | None | N/A |
| CA Building Energy Efficiency Standards – Title 24 | None | N/A |
| Federal Standards | Title 10 Section 431.462 | January 27, 2020 |



Program Requirements

Measure Implementation Eligibility

All combinations of measure application type, delivery type, and sector that are established for this measure are specified in Table 17 below. Measure application type is a categorization based on the circumstances and timing of the measure installation. Each measure application type is distinguished by its baseline determination, cost basis, eligibility, and documentation requirements. Delivery type is the broad categorization of the delivery channel through which the market intervention strategy (financial incentives or other services) is targeted. This table also designates the broad market sector(s) that are applicable for this measure.

Note that some of the implementation combinations below may not be allowed for some measure offerings by all program administrators.

Table 17: Measure Implementation Eligibility

| Measure Application Type | Sector | Delivery Type |
|--------------------------|--------|---------------|
| NC | Ag | DnDeemDl |
| NC | Ag | DnDeemed |
| NC | Ag | UpDeemed |
| NC | Com | DnDeemDI |
| NC | Com | DnDeemed |
| NC | Com | UpDeemed |
| NC | Ind | DnDeemDI |
| NC | Ind | DnDeemed |
| NC | Ind | UpDeemed |
| NR | Ag | DnDeemDI |
| NR | Ag | DnDeemed |
| NR | Ag | UpDeemed |
| NR | Com | DnDeemDI |
| NR | Com | DnDeemed |
| NR | Com | UpDeemed |
| NR | Ind | DnDeemDI |
| NR | Ind | DnDeemed |
| NR | Ind | UpDeemed |

Guidance for Measure Application Types

Per the CPUC's New Construction Measure Application Type Definition and Best Practices guidance, the following nontraditional installation scenarios differentiate the eligibility between new construction (NC) and normal replacement (NR) measure application types (including their respective



46

building vintages). For guidance on which delivery types are applicable to NC, please see the Measure Implementation Eligibility table above.

- Installing equipment where one was not installed previously (i.e. non-replacement project) -NR and Ex
- Installing equipment in an alteration or expansion project that increases footprint by less than 30 percent - NR and Ex
- Installing equipment in an alteration or expansion project that increases footprint by 30 percent or more NC and New

Title 24 and Permitting Requirements

Pursuant to Senate Bill SB1414 California Public Utilities Code Section 399.4 (b)(1), there are requirements on certification by the customer or contractor, indicating that the improvement or installation has complied with any applicable permitting requirements, including any applicable specifications or requirements set forth in the California Building Standards Code (Title 24 of the California Code of Regulations). Additionally, these requirements state that, if the contractor performed the installation or improvement, that the contractor hold the appropriate license for the work performed, in compliance with this measure application.

Eligible Products

Clean water pumps and wastewater pumps that are intended for agricultural, commercial, and industrial sectors are required to have a nominal pump motor horsepower rating of \leq 250 and meet the PEI requirements specified in the Measure Case Description section. The selection of offering IDs and incentivized units will be based on the rated pump motor horsepower. Additionally, the PEI should be confirmed on the HI database (https://er.pumps.org/ratings/searchy).

Any of the following clean water rotodynamic pump classes are eligible:

- End suction frame mount (ESFM)
- End suction close coupled (ESCC)
- In-line (IL)
- Radially split multi-stage vertical in-line diffuser casing (RSV)
- Vertical turbine submersible (ST)

For variable speed pumps, programs must verify that the pumps are operating at variable speed to achieve variable flow. The verification process includes providing photographs of the pump controls, pump management system, and/or a written description of the pump control strategy.



Eligible Building Types and Vintages

This measure is applicable for the following agricultural, commercial, or industrial building types of "New" and "Existing" vintages. Note that savings values for "Existing" vintage is also eligible for "Rec" and "Old" vintages. The "Commercial" building type (Com) is ineligible for downstream delivery types.



Table 18: Eligible Building Types and Sectors

| | ing Types and esection |
|---------------|------------------------|
| Building Type | Sector |
| AgOth | Ag |
| Asm | Com |
| Cnc | Com |
| Com | Com |
| CRe | Com |
| Dat | Com |
| ECC | Com |
| EPr | Com |
| ERC | Com |
| ESe | Com |
| EUD | Com |
| EUn | Com |
| Fhc | Com |
| Gro | Com |
| Gst | Com |
| HGR | Com |
| Hsp | Com |
| Htl | Com |
| IndOth | Ind |
| Mtl | Com |
| Nrs | Com |
| OfL | Com |
| OfS | Com |
| RFF | Com |
| RSD | Com |
| Rt3 | Com |
| RtL | Com |
| RtS | Com |
| s_Cli | Com |
| s_FSt | Com |
| s_MiC | Com |
| s_TCU | Com |
| SCn | Com |
| SUn | Com |
| Sup | Com |
| WRf | Com |



Eligible Climate Zones

This measure is applicable in all California climate zones.

Data Collection Requirements

Data collection requirements are described in Database for Energy Efficient Resources (DEER) Resolutions E-5152, E-5221, and the Final Impact Evaluation Non-Residential Deemed Pump and Food Service Program Year 2020, with the following objectives:

- 1. Better tracking of the installed equipment that received a rebate,
- 2. Ensuring that eligible measures are submitted in applications,
- 3. Ensuring that proper evaluation and application of savings are performed per California evaluation, measurement, and verification (EM&V) protocols, and
- 4. Ensuring that cost-effectiveness values are properly/correctly applied for each application/project.

Therefore, at a minimum, the following data must be collected:



Table 19: Data Collection Requirements for Incentived Heat Pump Equipment

| Data Collection Requirements | Required for Upstream | Required for Downstream and Direct Install |
|---|--------------------------|---|
| Site ID - A unique identifier for the shipping destination (upstream) or installed location (Midstream/Downstream/DI) of the incentivized equipment (e.g., site address). In addition, include service account ID for the site. | Yes | Yes |
| Quantity per site - Total units of incentivized equipment located at the site or project (HP) | Yes | Yes |
| Measure equipment ID 14 A unique identifier for each unit of incentivized equipment (e.g., serial number) | Yes | Yes |
| Measure equipment model number | Yes | Yes |
| Measure equipment manufacturer | Yes | Yes |
| Measure equipment rated efficiency (PEI) | Yes | Yes |
| Measure equipment control strategy (constant speed or variable speed) | Yes | Yes |
| Measure equipment class (i.e., end suction frame mount, end suction close coupled, in-line, radially split multi-stage vertical in-line diffuser casing, vertical turbine submersible) | Yes | Yes |
| Measure equipment motor horsepower (HP) | Yes | Yes |
| Invoices | Provide if available | Yes |
| Climate zone | Yes | Yes |
| Building type | Yes | Yes |
| Building vintage | Yes | Yes |

Electric Savings (kWh)

This unit energy savings (UES) analysis was adopted from the pump savings analysis approved by the Regional Technical Forum (RTF) for NEEA's Efficient Commercial and Industrial Pumps (ECIP) project. This analysis was approved in April 2022, and included extensive pump modeling, DOE database information, and customer and vendor field data.

The UES from retrofitting an existing pump to a more efficient measure case pump is based on the NEEA modification of the HI pump energy savings calculation. The HI energy savings calculation assumes a conservative base case efficiency scenario and does not include adjustment factors to

¹⁴ Exemptions to the equipment identifier requirement will be made for measure package offerings where leveraging a serial number or other practical unique identifier is infeasible. Exemptions will need to be approved by the CPUC in advance.



account for pump nominal power and actual pump performance variances. The NEEA modifications of the HI calculation considered baseline market average pump efficiencies and adjustment factors that reflect nominal versus actual power draw and actual pump system curves.

Per Final Impact Evaluation Non-Residential Deemed Pump and Food Service Program Year 2020, this measure package has been revised to reflect the most accurate and up-to-date PEI values available in the HI database. The base case PEI values were found by determining the most common PEI values for each speed control and pump motor horsepower bin. The measure case PEI tiers were set by incrementally improving the PEIs by values of 0.02 for each tier. These efficiency tiers were selected based on a review of the PEI distribution of eligible pumps in the HI pump database. Only two tiers were approved for the largest horsepower variable speed bin because no products currently exist in the highest PEI bin for that size and control combination.

The energy savings analysis NEEA was streamlined for this measure. The electric unit energy consumption (UEC) and UES for installing high-efficiency pumps were calculated using the calculations below. An identical measure case UEC calculation can be viewed on the Calculations tab.

Table 20: Annual Unit Energy Consumption - Electric, Baseline

```
Equation (kWh/Yr)
(opHrs opHrsY r · opHrs adjFactor · pumps size · pumps PElBase · const kW HP)
pumps__mtrSize

opHrs_opHrsYr = Annual operating hours (hr)
opHrs_adjFactor = Final load profile adjustment factors by application and speed control case
pumps_size = Representative pump size (HP)
pumps_PElBase = Base PElconst_kW_HP= Conversion factor of 0.746 (kW/HP)
pumps_mtrSize = Representative motor size (HP)
```

Table 21: Annual Unit Energy Savings - Electric

Equation (kWh/Yr)UEC_YrkWhBase - UEC_Y rkWhMeas

UEC_YrkWhBase = Annual unit energy consumption - electric, baseline (kWh/y)UEC_YrkWhMeas = Annual unit energy consumption - electric, measure case (kWh/y)

The inputs for the UEC calculations are specified below. Annual hours of operation and adjustment factors for differing pumping applications were adopted directly from the RTF analysis.



Table 22: Constants – Annual Operating Hours and Adjustment Factors

| Application Type | Control Strategy | Sector | Annual Operation Hours (Hr/Year) | Adjustment Factors (Ratio) |
|------------------|------------------|--------|-------------------------------------|----------------------------|
| Clean water | Constant Speed | Ag | 2358 | 1.3250 |
| Clean water | Constant Speed | Com | 3753 | 1.2500 |
| Clean water | Constant Speed | Ind | 6175 | 1.3100 |
| Clean water | Variable Speed | Ag | 2358 | 1.8450 |
| Clean water | Variable Speed | Com | 3753 | 1.0000 |
| Clean water | Variable Speed | Ind | 6175 | 1.2140 |
| Wastewater | Constant Speed | Ag | 4014 | 1.3100 |
| Wastewater | Constant Speed | Com | 1925 | 1.3100 |
| Wastewater | Constant Speed | Ind | 1690 | 1.3100 |
| Wastewater | Variable Speed | Ag | 4014 | 1.2140 |
| Wastewater | Variable Speed | Com | 1925 | 1.2140 |
| Wastewater | Variable Speed | Ind | 1690 | 1.2140 |

Pump parameters were derived using the same strategies as those in the RTF analysis but calculated specifically for this measure's horsepower bins. Pump motor oversizing values were taken as the average of oversizing percentages per relevant pump motor horsepower bins from the RTF workbook, originally sourced from the NEEA report, Extended Motor Products Savings Validation Research on Clean Water Pumps and Circulators. The motor oversizing percentage is the difference between the pump input power at the most efficient operating point and the rated motor horsepower. Representative horsepower values were calculated as the midpoint for each horsepower bin. The average oversizing percentage was then applied to the representative motor horsepower to derive the representative pump horsepower used for the calculations.



Table 23: Pump Parameters

| Pump Motor Horsepower | Measure PEI Range | Control Strategy | Average Oversize (%) | Representative Motor Size (HP) | Representative Pump Size (HP) | Base PEI (Ratio) | Measure PEI (Ratio) |
|-----------------------------|-------------------------|---------------------|----------------------------|--------------------------------------|-------------------------------------|------------------------|---------------------------|
| 1 ≤ HP ≤ 15 | ≤ 0.41 | Variable Speed | 0.3137 | 8 | 5.49 | 0.47 | 0.41 |
| 1 ≤ HP ≤ 15 | ≤ 0.43 | Variable Speed | 0.3137 | 8 | 5.49 | 0.47 | 0.43 |
| 1 ≤ HP ≤ 15 | ≤ 0.45 | Variable Speed | 0.3137 | 8 | 5.49 | 0.47 | 0.45 |
| 1 ≤ HP ≤ 15 | ≤ 0.88 | Constant Speed | 0.3137 | 8 | 5.49 | 0.94 | 0.88 |
| 1 ≤ HP ≤ 15 | ≤ 0.90 | Constant Speed | 0.3137 | 8 | 5.49 | 0.94 | 0.9 |
| 1 ≤ HP ≤ 15 | ≤ 0.92 | Constant Speed | 0.3137 | 8 | 5.49 | 0.94 | 0.92 |
| 15 < HP ≤ 50 | ≤ 0.43 | Variable Speed | 0.2184 | 32.5 | 25.4 | 0.49 | 0.43 |
| 15 < HP ≤ 50 | ≤ 0.45 | Variable Speed | 0.2184 | 32.5 | 25.4 | 0.49 | 0.45 |
| 15 < HP ≤ 50 | ≤ 0.47 | Variable Speed | 0.2184 | 32.5 | 25.4 | 0.49 | 0.47 |
| 15 < HP ≤ 50 | ≤ 0.88 | Constant Speed | 0.2184 | 32.5 | 25.4 | 0.94 | 0.88 |
| 15 < HP ≤ 50 | ≤ 0.90 | Constant Speed | 0.2184 | 32.5 | 25.4 | 0.94 | 0.9 |
| 15 < HP ≤ 50 | ≤ 0.92 | Constant Speed | 0.2184 | 32.5 | 25.4 | 0.94 | 0.92 |
| 50 < HP ≤ 250 | ≤ 0.45 | Variable Speed | 0.1662 | 150 | 125.07 | 0.49 | 0.45 |
| 50 < HP ≤ 250 | ≤ 0.47 | Variable Speed | 0.1662 | 150 | 125.07 | 0.49 | 0.47 |
| 50 < HP ≤ 250 | ≤ 0.89 | Constant Speed | 0.1662 | 150 | 125.07 | 0.95 | 0.89 |
| 50 < HP ≤ 250 | ≤ 0.91 | Constant Speed | 0.1662 | 150 | 125.07 | 0.95 | 0.91 |
| 50 < HP ≤ 250 | ≤ 0.93 | Constant Speed | 0.1662 | 150 | 125.07 | 0.95 | 0.93 |

Peak Electric Demand Reduction (kW)

Some peak demand reduction is expected to be associated with pump efficiency improvements. However, the project team was unable to find any studies regarding sector-specific peak demand reductions in California. Therefore, no peak demand reduction is being claimed for this measure.

Gas Savings (Therms)

Not applicable.



Life Cycle

Effective useful life (EUL) is an estimate of the median number of years that a measure installed through a program is still in place and operable. EUL is often, but not always, derived from measure persistence or retention studies. Remaining useful life (RUL) is an estimate of the median number of years that a technology or piece of equipment replaced or altered by an energy efficiency program would have remained in service and operational, had the program intervention not caused the replacement or alteration.

The EUL and RUL for this measure are specified below. This EUL was adopted for the 2008 DEER and is based on estimates reported in several California-based retention studies. Note that RUL is only applicable for add-on equipment and accelerated replacement measures and is not applicable for this measure.

Table 24: Effective Useful Life and Remaining Useful Life

| Effective Useful Life ID | EUL Description (Text) | Sector (Text) | EUL Years (Yr) | Start Date (Text) | Expire Date (Text) |
|-----------------------------|------------------------|---------------|-------------------|-------------------|--------------------|
| Motors-pump | Water Loop Pumps | Com | 15 | 41275 | |

Base Case Material Cost (\$/Unit)

See the Measure Case Material Cost (\$/Unit) section.

Measure Case Material Cost (\$/Unit)

Material cost for this measure was determined from the incremental cost (IMC) analysis developed by the Lincus team. The measure developer developed a clean water pump cost curve to calculate the incremental pump cost per both pump motor horsepower and PEI. This cost curve was used with the representative pump size values associated with this measure. Subsequently, the cost was multiplied by the delta PEI values for each measure tier to arrive at the normalized cost per pump motor horsepower for each measure. The IMC for wastewater pumps is considered to be the same as clean water pumps, as the motor horsepower and PEI are consistent across both applications. The incremental costs were calculated based on the following equation:



Table 25: Incremental Cost

Equation (USD)

(costCalcInputs_a · pumps_mtrSizecostCalcInputs_b) · (pumps_PEIBase - pumps_PEIMeas)

costCalc__a = Coefficient a from 2024 pump cost curve costCalc__b = Coefficient b from 2024 pump cost curve pumps__mtrSize = Representative motor size (HP) pumps__PElBase = Base PEl pumps__PElMeas = Measure PEl

The inputs for the IMC calculations are specified below.

Table 26: Costs - Calculation Inputs

| Pump Motor Horsepower | Measure PEI Range | Application Type | Control Strategy | A (number) | B (number) |
|--------------------------|----------------------|------------------|---------------------|---------------|---------------|
| 1 ≤ HP ≤ 15 | PEI ≤ 0.41 | Clean water | Variable Speed | 2092.3 | -0.71 |
| $1 \le HP \le 15$ | PEI ≤ 0.41 | Wastewater | Variable Speed | 2092.3 | -0.71 |
| $1 \le HP \le 15$ | PEI ≤ 0.43 | Clean water | Variable Speed | 2092.3 | -0.71 |
| $1 \le HP \le 15$ | PEI ≤ 0.43 | Wastewater | Variable Speed | 2092.3 | -0.71 |
| $1 \leq HP \leq 15$ | $PEI \leq 0.45$ | Clean water | Variable Speed | 2092.3 | -0.71 |
| $1 \le HP \le 15$ | PEI ≤ 0.45 | Wastewater | Variable Speed | 2092.3 | -0.71 |
| $1 \leq HP \leq 15$ | PEI ≤ 0.88 | Clean water | Constant Speed | 3006.9 | -0.64 |
| $1 \leq HP \leq 15$ | PEI ≤ 0.88 | Wastewater | Constant Speed | 3006.9 | -0.64 |
| $1 \leq HP \leq 15$ | PEI ≤ 0.90 | Clean water | Constant Speed | 3006.9 | -0.64 |
| $1 \leq HP \leq 15$ | PEI ≤ 0.90 | Wastewater | Constant Speed | 3006.9 | -0.64 |
| $1 \leq HP \leq 15$ | PEI ≤ 0.92 | Clean water | Constant Speed | 3006.9 | -0.64 |
| $1 \leq HP \leq 15$ | PEI ≤ 0.92 | Wastewater | Constant Speed | 3006.9 | -0.64 |
| 15 < HP ≤ 50 | PEI ≤ 0.43 | Clean water | Variable Speed | 2092.3 | -0.71 |
| 15 < HP ≤ 50 | PEI ≤ 0.43 | Wastewater | Variable Speed | 2092.3 | -0.71 |
| 15 < HP ≤ 50 | PEI ≤ 0.45 | Clean water | Variable Speed | 2092.3 | -0.71 |
| 15 < HP ≤ 50 | PEI ≤ 0.45 | Wastewater | Variable Speed | 2092.3 | -0.71 |
| 15 < HP ≤ 50 | PEI ≤ 0.47 | Clean water | Variable Speed | 2092.3 | -0.71 |
| 15 < HP ≤ 50 | PEI ≤ 0.47 | Wastewater | Variable Speed | 2092.3 | -0.71 |
| 15 < HP ≤ 50 | PEI ≤ 0.88 | Clean water | Constant Speed | 3006.9 | -0.64 |
| 15 < HP ≤ 50 | PEI ≤ 0.88 | Wastewater | Constant Speed | 3006.9 | -0.64 |
| 15 < HP ≤ 50 | PEI ≤ 0.90 | Clean water | Constant Speed | 3006.9 | -0.64 |
| 15 < HP ≤ 50 | PEI ≤ 0.90 | Wastewater | Constant Speed | 3006.9 | -0.64 |
| 15 < HP ≤ 50 | $PEI \leq 0.92$ | Clean water | Constant Speed | 3006.9 | -0.64 |
| 15 < HP ≤ 50 | PEI ≤ 0.92 | Wastewater | Constant Speed | 3006.9 | -0.64 |
| $50 < HP \le 250$ | $PEI \leq 0.45$ | Clean water | Variable Speed | 2092.3 | -0.71 |



| 50 < HP ≤ 250 | PEI ≤ 0.45 | Wastewater | Variable Speed | 2092.3 | -0.71 |
|---------------|-----------------|-------------|----------------|--------|-------|
| 50 < HP ≤ 250 | $PEI \leq 0.47$ | Clean water | Variable Speed | 2092.3 | -0.71 |
| 50 < HP ≤ 250 | PEI ≤ 0.47 | Wastewater | Variable Speed | 2092.3 | -0.71 |
| 50 < HP ≤ 250 | PEI ≤ 0.89 | Clean water | Constant Speed | 3006.9 | -0.64 |
| 50 < HP ≤ 250 | PEI ≤ 0.89 | Wastewater | Constant Speed | 3006.9 | -0.64 |
| 50 < HP ≤ 250 | PEI ≤ 0.91 | Clean water | Constant Speed | 3006.9 | -0.64 |
| 50 < HP ≤ 250 | PEI ≤ 0.91 | Wastewater | Constant Speed | 3006.9 | -0.64 |
| 50 < HP ≤ 250 | PEI ≤ 0.93 | Clean water | Constant Speed | 3006.9 | -0.64 |
| 50 < HP ≤ 250 | PEI ≤ 0.93 | Wastewater | Constant Speed | 3006.9 | -0.64 |

Base Case Labor Cost (\$/Unit)

See the Measure Case Labor Cost (\$/Unit) section.

Measure Case Labor Cost (\$/Unit)

There is no incremental labor cost assumed between the base and measure case equipment because both are similarly sized clean water pumps, only with different efficiencies. Therefore, no labor cost calculations were conducted for this measure.

Net-to-Gross

The net-to-gross (NTG) ratio represents the portion of gross impacts that are determined to be directly attributed to a specific program intervention. These NTG values are based upon the average of all NTG ratios for all evaluated 2006 to 2008 nonresidential sector programs, as documented in the 2011 DEER Update Study conducted by Itron, Inc. These sector average NTGs ("default NTGs") are applicable to all energy efficiency measures that have been offered through agriculture, commercial, and industrial sector programs for more than two years and for which impact evaluation results are not available.

Table 27: Net-to-Gross Ratio - Nonresidential

| Net-to-Gross Ratio ID | NTGRKWH (RATIO) | NTGRTHERM (RATIO) |
|-----------------------|--------------------|----------------------|
| Agric-Default>2yrs | 0.6 | 0.6 |
| Com-Default>2yrs | 0.6 | 0.6 |
| Ind-Default>2yrs | 0.6 | 0.6 |

Gross Savings Installation Adjustment

The gross savings installation adjustment (GSIA) rate represents the ratio of the number of verified installations of the measure to the number of claimed installations reported by the utility. This factor varies by end use, sector, technology, application, and delivery method. This GSIA rate is the current "default" rate specified for measures for which an alternative GSIA has not been estimated and approved.



Table 28: Gross Savings Installation Adjustments - Default

| GSIA ID | GSIA (Ratio) |
|----------|--------------|
| Def-GSIA | 1.0000 |

Non-Energy Impacts

Non-energy impacts for this measure have not been quantified.

DEER Differences Analysis

This section provides a summary of DEER-based inputs and methods, and the rationale for inputs and methods that are not DEER-based.

Table 29: DEER Difference Summary

| DEER Item | Comment |
|--------------------------------|---|
| Modified DEER methodology | No |
| Scaled DEER measure | No |
| DEER base case | No |
| DEER measure case | No |
| DEER building types | No |
| DEER operating hours | No |
| DEER eQUEST prototypes | No |
| DEER version | N/A |
| Reason for deviation from DEER | DEER does not contain this type of measure. |
| DEER measure IDs used | N/A |

Stakeholder Feedback

The ISP study request form and questionnaire was sent to the CPUC for their feedback. CPUC provided feedback on both documents on 7/26/2024. Revisions of the documents were resubmitted to the CPUC on 7/29/2024.

A representative from Motion Industries sent an inquiry about this CalNEXT Market Study (ET24SWE0038). Following the inquiry, ISP surveys were conducted to obtain stakeholder feedback from Motion Industries and Grundfos through this program inquiry. Stakeholder feedback was gathered through performing the ISP surveys.



Next Steps

- 1. ISP Study Report The project team has submitted the ISP study report to SCE for review. Any revisions will be addressed and the report will be submitted to the CPUC for review.
- Measure Package Update Program Year 2025 Cal TF has reviewed the draft measure package and it is now with SCE for review. The project team will coordinate with SCE to address comments and move the measure package through the CPUC review process.
- Measure Package Update Program Year 2026 The project team will coordinate with SCE's measure package team and CalNEXT to get approval on the ISP study report and update SWWP004 for Program Year 2026 with the recommended ISP baseline from the finalized ISP study report.



References

- Albers, Ryan Bliss and Nathaniel. 2022. Extended Motor Products Regional Market Share Study. NEEA.
- Avijit Mallik, Md. Arman Arefin and Mhia Md. Zaglul Shahadat. 2018. "Design and feasibility analysis for a low-cost water treatment plant for rural regions of Bangladesh." Agriculture and Food 181-204.
- California Energy Efficiency Measure Data. 2023. *Water Pump Upgrade*. Accessed July 15, 2024. https://www.caetrm.com/measure/SWWP004/03/.
- n.d. CalNEXT. Accessed 10 18, 2023. https://calnext.com/.
- Northwest Energy Efficiency Alliance (NEEA). 2023. *Efficient Pumps*. April. Accessed October 10, 2024. https://nwcouncil.app.box.com/v/comagindefficpumps-4-0.



Appendix A: ISP Survey Questionnaire

Water Pump Upgrade ISP Survey Questionnaire

Subject Matter Experts/Consulting Firms/Customer Facility Personnel:

1. What is your current title/role? 2. How many years of experience do you have in pumping systems? 3. What types of experience do you have in pumping systems? [Note: If response to (2) and (3) shows no/limited experience to provide input for the survey, thank the interviewee and terminate the call]. 4. Which specific customer types/segments purchase "clean water pumps" as defined above? (Check all that apply) ☐ Agricultural ☐ Commercial □ Industrial ☐ Municipal ☐ Residential □ Wastewater ☐ Other: Click or tap here to enter text. Ilf response to Question 4 indicates this interviewee is familiar with wastewater customer segment, ask Question 5, if not, skip Question 5 and proceed to Question 6] 5. Are there variations in pump types sold in the wastewater customer segment versus other segments? ☐ Yes □No [If answer to question 5 is Yes, then ask questions 6-11 for both non-wastewater and wastewater segments.1 6. What percentage of customers are aware of the Department of Energy's pump efficiency index (PEI) rating for Pump Energy Conservation Standards: ☐ Less than 25% □ 25%-50% □ 50%-75% □ 75%+ ☐ Don't know ☐ Can provide later 7. What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., 0.5-1.0)? Responses may be specific PEI rating or one of the following ranges <0.8, 0.81–0.89, 0.90–0.93,



0.94-0.98, 0.98-1.0, I don't know

a. 1-15 horsepower: Click or tap here to enter text.

 $\square < 0.8 \quad \square \ 0.81 - 0.89 \quad \square \ 0.90 - 0.93 \quad \square \ 0.94 - 0.98 \quad \square \ 0.98 - 1.0 \quad \square \ | don't know$

| b. 15-50 | horsepower: Cli | ck or tap here to | enter text. | | |
|-----------------------------------|--|--|---|-----------------------------|---|
| □ <0.8 | □ 0.81-0.89 | □ 0.90-0.93 | □ 0.94-0.98 | □ 0.98-1.0 | ☐ I don't know |
| c. 50-25 □ <0.8 | · | lick or tap here t ☐ 0.90-0.93 | o enter text. ☐ 0.94-0.98 | □ 0.98-1.0 | □ I don't know |
| range (e.g Response | g., 0.3-0.50)? | ic PEI rating or o | _ | | mps by rated motor HP 0.31-0.39, 0.40-0.43, |
| | , | | | | |
| a. 1-15 r □ <0.3 | orsepower: Click □ 0.31-0.39 | or tap here to e ☐ 0.40-0.43 | □ 0.44-0.48 | □ 0.48-0.50 | ☐ I don't know |
| | | ck or tap here to | | □ 0.48-0.50 | ☐ I don't know |
| □ <0.3 [Note: Pro | □ 0.31–0.39 obe to see if they ne PEI rating that | consider anythi | □ 0.44-0.48 | 0 as efficient. If | they do, probe to define |
| Do you sp | | | at are the key tec ng pumps for the | | onsidered? |
| Does pun | np PEI rating affe | | | | ey factors considered? en selecting a pump? |
| cost, relia they can [[| ability, past exper provide ranking I Initial Cost I Operating Cost, I Reliability | rience, efficiency from most impor /Efficiency | , utility savings, μ tant to least imp | oroduct availabi ortant] | e.g., initial cost, operating lity). [Note: Ask to see if |
| | Availability | e/Spare parts co cap here to enter | onsistency/Manu text. | racturer or type | consistency |
| If so | | | e of PEI ratings o ndations are effic | | |



| □ I don't knowAre efficient pumps readily available for purchase?□ Yes□ No□ Not Sure |
|---|
| Pump Manufacturers: 1. What is your current title/role? |
| 2. How many years of experience do you have in pumping systems? |
| 3. What types of experience do you have in pumping systems? [Note: If response to (2) and (3) shows no/limited experience to provide input for the survey, thank the interviewee and terminate the call] |
| 4. Which of the following pump equipment classes does your company sell? (Check all that apply) □ ESCC: end suction close coupled pump □ ESFM: end suction frame mounted pump □ IL: in-line close coupled and split coupled pumps □ RSV: radially split, multistage, vertical, in-line casing diffuser pump □ Submersible vertical turbines pump [If response to Question 4 indicates this interviewee is familiar with wastewater customer segment, ask Question 5, if not, skip Question 5 and proceed to Question 6] |
| 5. Are there variations in pump types sold in the wastewater customer segment versus other segments? ☐ Yes ☐ No [If answer to question 5 is Yes, then ask questions 6–13 for both non-wastewater and wastewater segments.] |
| 6. Which sector(s) does your company sell "clean water pumps" to, as defined above? (Check all that apply) Agricultural Commercial Industrial Municipal Residential Wastewater Other: Click or tap here to enter text. |
| 7. What range of pump sizes (in rated-motor horsepower) does your company typically sell? What is the most common size? [Note: Last three years is the preferred time period] 1-15 horsepower 15-50 horsepower 50-250 horsepower Most common size sold - Click or tap here to enter text. |



8. Are you aware of the Department of Energy's established metric, pump efficiency index (PEI) rating for Pumping System Energy Standards?

| | Yes | □ No | | | | | | |
|---|--|---|---|------------------------|---------------|--------------|-------------|-------------------|
| 9. Do you factor? | advise | or recom | mend to poten | itial custome | rs selection | of pumps b | pased on t | their PEI ratings |
| | Yes | □ No | | | | | | |
| | _ | | nto the custom □ I don't know | | naking proc | ess when p | urchasing | ; a pump? |
| | _ | - | ed in the custo □ I don't know | | cal specifica | itions or eq | uipment o | order? |
| ranges (up a. 1–15 h Cli Cli b. 15–50 Cli | o to three orsepond ck or take | ee): wer ap here to ap here to ower ap here to | o enter text. | ump models i | n the last 1 | 2 months v | vithin the | following |
| | is the referred to | elative qu ime perio | o enter text. uantity of pump od] | os sold annua | Illy by rated | HP range? | [Note: La | st three years |
| b. 15-50 | horsep | | □ 1000s | | | | | |
| □ c. 50-250 | | ☐ 100s power | □ 1000s | | | | | |
| | 10s | □ 100s | □ 1000s | | | | | |
| <u>Pump Ver</u> 1. What is | | | on Contractors, e/role? | <u>Distributors</u>) | <u>:</u> | | | |
| 2. How ma | any yea | rs of exp | erience do you | have in pum | ping system | s? | | |
| • | • | • | ce do you have nce to provide i | | - | | , | , , , |
| apply) □ □ | ESCC: ESFM: | end suct | oump equipment ion close coupl tion frame mou | led pump inted pump | · | ıpany sell/i | install? (C | heck all that |



| | □ RSV: radially split, multistage, vertical, in-line casing diffuser pump□ Submersible vertical turbines pump |
|----------------------------|---|
| | n sector(s) does your company sell/install "clean water pumps" to, as defined above? (Check |
| all that a | |
| | □ Agricultural |
| [| ☐ Commercial |
| [| □ Industrial |
| [| □ Municipal |
| [| ☐ Residential |
| [| ☐ Wastewater |
| [| □ Other: Click or tap here to enter text. |
| | onse to Question 5 indicates this interviewee is familiar with wastewater customer segment, estion 6, if not, skip Question 6 and proceed to Question 7] |
| 6. Are th | nere variations in pump types sold in the wastewater customer segment versus other ts? |
| [| □ Yes |
| [| □No |
| [If answo | er to question 6 is Yes, then ask questions 7–16 for both non-wastewater and wastewater ts.] |
| the mos I | range of pump sizes (in rated-motor horsepower) does your company typically sell? What is st common size? [Note: Last three years is the preferred time period] 1–15 HP 15–50 HP |
| [| □ 50-250 HP |
| | Most common size sold – Click or tap here to enter text. |
| for Pum | bu aware of the Department of Energy's established metric, pump efficiency index (PEI) rating ping System Energy Standards? \Box Yes \Box No |
| 9. Do yo factor? | ou advise or recommend to potential customers selection of pumps based on their PEI ratings |
| | □ Yes □ No |
| | PEI ratings factor into the customer decision-making process when purchasing a pump? \Box Yes \Box No \Box I don't know |
| | PEI ratings specified in the customer's technical specifications or equipment order? \Box Yes \Box No \Box I don't know |
| years wi a. 1-15 l (| at are the most common sold/installed pump manufacturer and models in the last three ithin the following ranges (up to three): horsepower Click or tap here to enter text. Click or tap here to enter text. |



| | o enter text. | mps sold annually by rated HP range? [Note: Last three years |
|--|---|--|
| is the preferred time perio a. 1–15 horsepower | od] | |
| ☐ 10s ☐ 100s b. 15-50 horsepower | □ 1000s | ☐ Click or tap here to enter text. |
| ☐ 10s ☐ 100s c. 50-250 horsepower | □ 1000s | ☐ Click or tap here to enter text. |
| □ 10s □ 100s | □ 1000s | \square Click or tap here to enter text. |
| and variable speed pump a. Constant Speed 1–15 l b. Constant Speed 15–50 c. Constant Speed 50–25 d. Variable Speed 1–15 h e. Variable Speed 15–50 f. Variable Speed 50–250 | s by rated HF horsepower -) horsepower 60 horsepower orsepower - horsepower) horsepower | r is the PEI rating customer consider as efficient for constant P range. - Click or tap here to enter text. - Click or tap here to enter text. - Click or tap here to enter text. Click or tap here to enter text. - Click or tap here to enter text. ent pumps account for in the last three years? |
| ☐ I don't know | | |
| (E.g., Initial cost, operating ☐ Initial Cost ☐ Operating Cost, ☐ Reliability | g cost, reliabi /Efficiency e/Spare part | eustomer considers when choosing a pump for installation? ility, past experience, efficiency, utility savings, etc.) ts consistency/Manufacturer or type consistency inter text. |
| | | |

<u>VFD Vendors (Installation Contractors, Distributors):</u> 1. What is your current title/role?

- 2. How many years of experience do you have in pumping systems?



| 3. What types of experience do you have in pumping systems? [Note: If response to (2) and (3) shows no/limited experience to provide input for the survey, thank the interviewee and terminate the call]. |
|--|
| 4. Which of the following pump equipment classes does your company sell/or for which you install VFDs to? (Check all that apply) □ ESCC: end suction close coupled pump □ ESFM: end suction frame mounted pump □ IL: in-line close coupled and split coupled pumps □ RSV: radially split, multistage, vertical, in-line casing diffuser pump □ Submersible vertical turbines pump |
| 5. Which sector(s) does your company sell/install VFDs for "clean water pumps" to, as defined above? (Check all that apply) Agricultural Commercial Industrial Municipal Residential Wastewater Other: Click or tap here to enter text. [If response to Question 5 indicates this interviewee is familiar with wastewater customer segment, ask Question 6, if not, skip Question 6 and proceed to Question 7] |
| 6. Are there variations in pump types in the wastewater customer segment versus other segments? ☐ Yes ☐No |
| [If answer to question 6 is Yes, then ask questions 7–16 for both non-wastewater and wastewater segments.] |
| 7. What range of pump sizes (in rated-motor horsepower) does your company typically sell VFDs for? What is the most common size? [Note: Last three years is the preferred time period] □ 1–15 HP □ 15–50 HP □ 50–250 HP Most common size sold – Click or tap here to enter text. |
| 8. Are you aware of the Department of Energy's established metric, pump efficiency index (PEI) ratin for Pumping System Energy Standards? |
| 9. Do you advise or recommend to potential customers selection of VFDs, and motors based on how it would affect their PEI ratings factor? ☐ Yes ☐ No |
| 10. Do PEI ratings factor into the customer decision-making process when purchasing a VFD for the |



| ☐ Yes ☐ No ☐ I don't know |
|--|
| 11. Are PEI ratings specified in the customer's technical specifications or equipment order? \Box Yes \Box No \Box I don't know |
| 12. What are the most common pump manufacturer and models associated with the VFD sold/installed to projects completed in the last three years within the following ranges (up to three): a. 1–15 horsepower Click or tap here to enter text. |
| Click or tap here to enter text. Click or tap here to enter text. |
| b. 15–50 horsepower Click or tap here to enter text. Click or tap here to enter text. |
| Click or tap here to enter text. c. 50–250 horsepower Click or tap here to enter text. Click or tap here to enter text. |
| Click or tap here to enter text. |
| 13. What is the relative quantity of VFDs sold to pumps annually by pump rated HP range? [Note: This is not the rated HP of the VFD, but of the pump motor. Last three years is the preferred time period] |
| a. 1–15 horsepower □ 10s □ 100s □ Click or tap here to enter text. |
| b. 15–50 horsepower ☐ 10s ☐ 100s ☐ 1000s ☐ Click or tap here to enter text. |
| c. 50–250 horsepower ☐ 10s ☐ 100s ☐ Click or tap here to enter text. |
| 14. What is the PEI rating customers consider as efficient for variable speed pumps by rated HP range. |
| Variable Speed 1–15 horsepower – Click or tap here to enter text. Variable Speed 15–50 horsepower – Click or tap here to enter text. Variable Speed 50–250 horsepower – Click or tap here to enter text. |
| 15. What percentage of sales do efficient pumps with variable load account for in the last three years? |
| □ Less than 25% □ 25%-50% □ 50%-75% □ 75+% |
| ☐ I don't know |
| 16. What are the main factors that a customer considers when choosing a pump with VFD for installation? (E.g., Initial cost, operating cost, reliability, past experience, efficiency, utility savings, etc.) |
| ☐ Initial Cost ☐ Operating Cost/Efficiency |



| ☐ Reliability |
|---|
| \square Prior Experience/Spare parts consistency/Manufacturer or type consistency |
| ☐ Efficiency |
| ☐ Availability |
| ☐ Other: Click or tap here to enter text. |



Appendix B: ISP Survey Responses

Interview 1: Pump Vendor

- 1. What is your current title/role? Director of Engineering, previous owner, president; semi-retired
- 2. How many years of experience do you have in pumping systems? 40 years
- 3. What types of experience you have in pumping systems? Experience in managing large municipalities and contracts with cities, designing well pumps, booster stations, modify and engineer new products, VFDs, pump efficiency
- 4. Which of the following pump equipment classes does your company sell/install? (Check all that apply)

 - ESFM: end suction frame mounted pump
 - ☑ IL: in-line close coupled and split coupled pumps

smaller than typical - OCSD has big pumps - 500 HP

- ☑ RSV: radially split, multistage, vertical, in-line casing diffuser pump
- **☒** Submersible vertical turbines pump

| 5. | Which sector(s) does your company sell/install "clean water pumps" to, as defined above? (Check all that apply) |
|----|---|
| | ☑ Agricultural |
| | □ Commercial |
| | |
| | |
| | ☐ Residential |
| | |
| | ☐ Other: Click or tap here to enter text. |
| 6. | Are there variations in pump types sold in the wastewater customer segment versus other segments? |
| | ⊠ Yes |
| | □No |
| 7. | What range of pump sizes (in rated-motor horsepower) does your company typically sell? What is the most common size? [Note: Last three years is the preferred time period] \Box 1–15 HP |
| | □ 15-50 HP |
| | ⊠ 50-250 HP |



Most common size sold - 300 HP - bigger pumps; WW-mixed flow propeller type pumps -

| 8. | Are you aware of the Department of Energy's established metric, pump efficiency index (PEI) rating for Pumping System Energy Standards? \square Yes \square No |
|-----|---|
| 9. | Do you advise or recommend to potential customers selection of pumps based on their PEI ratings factor? \boxtimes Yes \square No |
| 10. | . Do PEI ratings factor into the customer decision-making process when purchasing a pump? \boxtimes Yes \square No \square I don't know |
| 11. | Are PEI ratings specified in the customer's technical specifications or equipment order? \boxtimes Yes \square No \square I don't know |
| 12. | What are the most common sold/installed pump manufacturer and models in the last three years within the following ranges (up to three): a. 1–15 horsepower i.Click or tap here to enter text. ii.Click or tap here to enter text. iii.Click or tap here to enter text. b. 15–50 horsepower i.Click or tap here to enter text. ii.Click or tap here to enter text. ii.Click or tap here to enter text. iii.Click or tap here to enter text. c. 50–250 horsepower i.Click or tap here to enter text. iii.Click or tap here to enter text. iii.Click or tap here to enter text. iii.Click or tap here to enter text. Vertical Turbines – multistage deep set for well, shallow for booster – Goulds, Hydroflow, Flowserve are most common brands. |
| 13. | What is the relative quantity of pumps sold annually by rated HP range? [Note: Last three years is the preferred time period] a. 1–15 horsepower |
| | □ 10s □ 100s □ Click or tap here to enter text. b. 15-50 horsepower |
| | ☐ 10s ☐ 100s ☐ 100os ☐ Click or tap here to enter text. |
| | c. $50-250$ horsepower \square 10s \square 100s \boxtimes 1000s \square Click or tap here to enter text. |
| 14. | If yes, to the above question, what is the PEI rating customer consider as efficient for constant and variable speed pumps by rated HP range. Constant Speed 1–15 horsepower – Click or tap here to enter text. Constant Speed 15–50 horsepower – Click or tap here to enter text. Constant Speed 50–250 horsepower – 70% OPE, no input on PEI rating Variable Speed 1–15 horsepower – Click or tap here to enter text. Variable Speed 50–250 horsepower – Click or tap here to enter text. Variable Speed 50–250 horsepower – Click or tap here to enter text. |

15. What percentage of sales do efficient pumps account for in the last three years?



| | Less than 25% □ 25%-50% □ 50%-75% ☑ 75+% [90% of sales are efficient pumps - large pumps municipalities] □ I don't know |
|----|--|
| 16 | . What are the main factors that a customer considers when choosing a pump for installation? (E.g. Initial cost, operating cost, reliability, past experience, efficiency, utility savings, etc.) ☑ Initial Cost − 3 ☐ Operating Cost/Efficiency ☑ Reliability − 1 ☐ Prior Experience/Spare parts consistency/Manufacturer or type consistency ☑ Efficiency − 2 ☐ Availability ☐ Other: Click or tap here to enter text. |
| | iew 2: Pump Vendor What is your current title/role? Vice President |
| 2. | How many years of experience do you have in pumping systems? 35 years of experience |
| 3. | What types of experience you have in pumping systems? Testing pumps, irrigation systems, energy efficiency in pumping systems, vibration analysis, pump efficiency test |
| 4. | Which of the following pump equipment classes does your company sell/install? (Check all that apply) ☑ ESCC: end suction close coupled pump ☑ ESFM: end suction frame mounted pump ☑ IL: in-line close coupled and split coupled pumps ☑ RSV: radially split, multistage, vertical, in-line casing diffuser pump ☑ Submersible vertical turbines pump |
| 5. | Which sector(s) does your company sell/install "clean water pumps" to, as defined above? (Check all that apply) ✓ Agricultural – 50% ✓ Commercial ✓ Industrial ✓ Municipal –50% ✓ Residential ✓ Wastewater □ Other: Click or tap here to enter text. |
| 6. | Are there variations in pump types sold in the wastewater customer segment versus other |



segments?

| | ⊠ ' □N | Yes – grinder pumps in ww vs turbines, lower rpm in clean water No |
|-----|-----------|---|
| 7. | | nat range of pump sizes (in rated-motor horsepower) does your company typically sell? nat is the most common size? [Note: Last three years is the preferred time period] |
| | | Clean Water Pumps 1-15 HP 15-50 HP 50-250 HP ost common size sold - Click or tap here to enter text. |
| | | Wastewater Pumps 1–15 HP 15–50 HP 50–250 HP ost common size sold – Click or tap here to enter text. |
| 8. | rat | e you aware of the Department of Energy's established metric, pump efficiency index (PEI ing for Pumping System Energy Standards? Yes 🛮 No |
| 9. | rat | you advise or recommend to potential customers selection of pumps based on their PEI ings factor? Yes $\ oxed{\boxtimes}\ \mathbf{No}$ |
| 10 | | PEI ratings factor into the customer decision-making process when purchasing a pump? Yes $\ oxdot \ \ oxdot $ |
| 11. | | PEI ratings specified in the customer's technical specifications or equipment order? Yes 🗵 No 🗆 I don't know |
| 12 | yea | nat are the most common sold/installed pump manufacturer and models in the last three are within the following ranges (up to three): 1–15 horsepower i.Click or tap here to enter text. ii.Click or tap here to enter text. |
| | b. | iii.Click or tap here to enter text. 15–50 horsepower i.Click or tap here to enter text. ii.Click or tap here to enter text. |
| | C. | iii.Click or tap here to enter text. 50-250 horsepower i.Click or tap here to enter text. ii.Click or tap here to enter text. iii.Click or tap here to enter text. |

13. What is the relative quantity of pumps sold annually by rated HP range? [Note: Last three years is the preferred time period]



| b | 1. 1-15 horsepower □ 10s □ 100s □ 1000s □ Click or tap here to enter text. 1. 15-50 horsepower □ 10s □ 100s □ 1000s □ Click or tap here to enter text. 1. 50-250 horsepower □ 10s □ 100s □ 1000s □ Click or tap here to enter text. |
|----------------------------|--|
| c a b c | f yes, to the above question, what is the PEI rating customer consider as efficient for constant and variable speed pumps by rated HP range. Constant Speed 1–15 horsepower – Click or tap here to enter text. Constant Speed 15–50 horsepower – Click or tap here to enter text. Constant Speed 50–250 horsepower – Click or tap here to enter text. Variable Speed 1–15 horsepower – Click or tap here to enter text. Variable Speed 15–50 horsepower – Click or tap here to enter text. Variable Speed 50–250 horsepower – Click or tap here to enter text. |
| [] [| What percentage of sales do efficient pumps account for in the last three years? Less than 25% 25%-50% 50%-75% 75+% I don't know |
| () [] [] [] [] | What are the main factors that a customer considers when choosing a pump for installation? E.g. Initial cost, operating cost, reliability, past experience, efficiency, utility savings, etc.) Initial Cost Operating Cost/Efficiency Reliability Prior Experience/Spare parts consistency/Manufacturer or type consistency Efficiency Availability Other: Click or tap here to enter text. |
| | Can we reach out to you to follow up if we have further questions? Yes |
| | Could you refer us to anyone knowledgeable about pumps that would be willing to participate in this survey? If so, could you share their contact information? |

Interview 3: Subject Matter Expert

- What is your current title/role?
 Consultant in the water industry specializing in Energy Efficiency, water operations, SCADA, compliance
- 2. How many years of experience do you have in pumping systems? 44 years of experience



| 3. | What types of experience do you have in pumping systems? Production supervisor/manager – 15–20 years, pumping plans, engineering work |
|----|---|
| 4. | Which specific customer types/segments purchase "clean water pumps" as defined above? (Check all that apply) ☑ Agricultural ☑ Commercial ☑ Industrial ☑ Municipal ☑ Residential ☐ Wastewater ☐ Other: Click or tap here to enter text. |
| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? $\hfill Yes \\ \hfill No$ |
| 6. | What percentage of customers are aware of the Department of Energy's pump efficiency index (PEI) rating for Pump Energy Conservation Standards: ☑ Less than 25% ☐ 25%-50% ☐ 50%-75% ☐ 75%+ ☐ Don't know ☐ Can provide later |
| 7. | What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., 0.5–1.0)? Responses may be specific PEI rating or one of the following ranges <0.8, 0.81–0.89, 0.90-0.93, 0.94–0.98, 0.98–1.0, I don't know |
| | a. 1–15 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know b. 15–50 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know c. 50–250 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know |
| 8. | What is the most commonly purchased PEI rating for variable speed pumps by rated motor HP range (e.g., 0.3–0.50)? Responses may be specific PEI rating or one of the following ranges <0.3, 0.31–0.39, 0.40-0.43, 0.44–0.48, 0.48–0.50, I don't know |
| | a. 1-15 horsepower: □ <0.3 □ 0.31-0.39 □ 0.40-0.43 □ 0.44-0.48 □ 0.48-0.50 ⊠ I don't know b. 15-50 horsepower: □ <0.3 □ 0.31-0.39 □ 0.40-0.43 □ 0.44-0.48 □ 0.48-0.50 ⊠ I don't know |



| | c. 50–250 horsepower: \square <0.3 \square 0.31–0.39 \square 0.40–0.43 \square 0.44–0.48 \square 0.48–0.50 \boxtimes I don't know |
|--------|---|
| 9. | If you specify pumps for customers, what are the key technical factors considered? a. Do you specify pump PEI ratings in selecting pumps for the customer? ☐ Yes ☑ No |
| 10 | . When deciding on purchasing new or replacing pumps, what are the key factors |
| | considered? a. Does pump PEI rating affect the customer's decision-making process when selecting a pump? |
| | ☐ Yes ☒ No ☐ I don't know |
| | b. What are the criteria customers consider when purchasing a pump? (e.g., initial cost, operating cost, reliability, past experience, efficiency, utility savings, product availability) Initial Cost - 1 |
| | ☑ Operating Cost/Efficiency – 1☑ Reliability – 3 |
| | ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency – 2 |
| | ⊠ Availability – 4 |
| | ☐ Other: Click or tap here to enter text. |
| 11 | Are pump vendors you work with aware of PEI ratings of pumps? a. If so, what percent of their recommendations are efficient pumps? □ Less than 25% □ 25%-50% □ 50% - 75% |
| | □ 75%+ |
| | ☑ I don't know |
| | b. Are efficient pumps readily available for purchase?☑ Yes □ No □ Not Sure |
| Interv | iew 4: Subject Matter Expert |
| 1. | What is your current title/role? Manager of Technical Programs |
| 2. | How many years of experience do you have in pumping systems? 7 years |
| 3. | What types of experience do you have in pumping systems? |
| 4. | Which specific customer types/segments purchase "clean water pumps" as defined above? (Check all that apply) ☑ Agricultural ☑ Commercial ☑ Industrial |
| | ⊠ Municipal |



| | ☑ Residential – multifamily ☑ Wastewater ☐ Other: Click or tap here to enter text. |
|----|--|
| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? ☑ Yes – different casing, different impeller □No |
| 6. | What percentage of customers are aware of the Department of Energy's pump efficiency index (PEI) rating for Pump Energy Conservation Standards: ☑ Less than 25% – End user / Contractor (installer) ☐ 25%-50% ☐ 50%-75% ☑ 75%+-Distributor ☐ Don't know ☐ Can provide later |
| 7. | What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., 0.5–1.0)? Responses may be specific PEI rating or one of the following ranges <0.8, 0.81–0.89, 0.90–0.93, 0.94–0.98, 0.98–1.0, I don't know – Northwest Energy Efficiency Alliance (NEEA) would have some data on this |
| | a. 1–15 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know b. 15–50 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know c. 50–250 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know |
| 8. | What is the most commonly purchased PEI rating for variable speed pumps by rated motor HP range (e.g., 0.3–0.50)? Responses may be specific PEI rating or one of the following ranges <0.3, 0.31–0.39, 0.40–0.43, 0.44–0.48, 0.48–0.50, I don't know |
| | a. 1–15 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31–0.39 □ 0.40–0.43 □ 0.44–0.48 □ 0.48–0.50 ⊠ I don't know b. 15–50 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31–0.39 □ 0.40–0.43 □ 0.44–0.48 □ 0.48–0.50 ⊠ I don't know c. 50–250 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31–0.39 □ 0.40–0.43 □ 0.44–0.48 □ 0.48–0.50 ⊠ I don't know |
| 9. | If you specify pumps for customers, what are the key technical factors considered? Selection based on duty point, then compare PEI or energy rating a. Do you specify pump PEI ratings in selecting pumps for the customer? |



| | ⊔ Yes ⊠ No |
|--------|--|
| 10 | . When deciding on purchasing new or replacing pumps, what are the key factors considered? Availability |
| | a. Does pump PEI rating affect the customer's decision-making process when selecting a pump? |
| | ☐ Yes ☒ No ☐ I don't know [DoE posted a motor market assessment that give %] |
| 11 | . What are the criteria customers consider when purchasing a pump? (e.g., initial cost, operating cost, reliability, past experience, efficiency, utility savings, product availability). ☑ Initial Cost – 3 ☑ Operating Cost/Efficiency – 4 |
| | ☑ Reliability - 4 ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency - 4 |
| | ☑ Availability – 2☑ Other: Form, fit, and function – 1 |
| 12 | Are pump vendors you work with aware of PEI ratings of pumps? a. If so, what percent of their recommendations are efficient pumps? □ Less than 25% |
| | □ 25%-50% □ 50%-75% □ 75%+ |
| | ☐ I don't know |
| | b. Are efficient pumps readily available for purchase?☑ Yes □ No □ Not Sure |
| Interv | iew 5: Subject Matter Expert |
| 1. | What is your current title/role? Manager of Business development / education/ training / energy efficiency resource |
| 2. | How many years of experience do you have in pumping systems? 25 years |
| 3. | What types of experience do you have in pumping systems? |
| 4. | Which specific customer types/segments purchase "clean water pumps" as defined above? (Check all that apply) |
| | □ Agricultural □ Commonwial |
| | ☑ Commercial☑ Industrial |
| | ☑ Municipal |
| | ⊠ Residential – multifamily |
| | ✓ Wastewater |
| | □ Other: Click or tap here to enter text. |



| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? ☑ Yes – different casing, different impeller □No |
|-----|---|
| 6. | What percentage of customers are aware of the Department of Energy's pump efficiency index (PEI) rating for Pump Energy Conservation Standards: ☑ Less than 25% - End user / Contractor (installer) ☐ 25%-50% ☐ 50%-75% ☑ 75%+ - Distributor ☐ Don't know ☐ Can provide later |
| 7. | What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., $0.5-1.0$)? Responses may be specific PEI rating or one of the following ranges <0.8, $0.81-0.89$, $0.90-0.93$, $0.94-0.98$, $0.98-1.0$, I don't know |
| | a. 1–15 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know b. 15–50 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know c. 50–250 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know |
| 8. | What is the most commonly purchased PEI rating for variable speed pumps by rated motor HP range (e.g., 0.3 – 0.50)? Responses may be specific PEI rating or one of the following ranges <0.3, 0.31 – 0.39 , 0.40 – 0.43 , 0.44 – 0.48 , 0.48 – 0.50 , I don't know a. 1–15 horsepower: Click or tap here to enter text. \square <0.3 \square 0.31–0.39 \square 0.40–0.43 \square 0.44–0.48 \square 0.48–0.50 \boxtimes I don't know b. 15–50 horsepower: Click or tap here to enter text. \square <0.3 \square 0.31–0.39 \square 0.40–0.43 \square 0.44–0.48 \square 0.48–0.50 \boxtimes I don't know c. 50–250 horsepower: Click or tap here to enter text. \square <0.3 \square 0.31–0.39 \square 0.40–0.43 \square 0.44–0.48 \square 0.48–0.50 \boxtimes I don't know |
| 9. | If you specify pumps for customers, what are the key technical factors considered? Selection based on duty point, then compare PEI or energy rating a. Do you specify pump PEI ratings in selecting pumps for the customer? □ Yes ☑ No |
| 10. | When deciding on purchasing new or replacing pumps, what are the key factors considered? Availability a. Does pump PEI rating affect the customer's decision-making process when selecting a pump? |



| | ☐ Yes ☒ No ☐ I don't know [DoE posted a motor market assessment that give %] |
|--------|---|
| 11 | . What are the criteria customers consider when purchasing a pump? (e.g., initial cost, operating cost, reliability, past experience, efficiency, utility savings, product availability). Initial Cost – 3 |
| | □ Operating Cost/Efficiency – 4 |
| | ⊠ Reliability – 4 |
| | ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency – 4 |
| | ⊠ Availability – 2 |
| | Other: Form, fit, and function − 1 |
| 12 | Are pump vendors you work with aware of PEI ratings of pumps? b. If so, what percent of their recommendations are efficient pumps? □ Less than 25% □ 25%-50% □ 50% - 75% ☑ 75%+ □ I don't know c. Are efficient pumps readily available for purchase? ☑ Yes □ No □ Not Sure |
| Interv | iew 6: Subject Matter Expert |
| 1. | What is your current title/role? Deputy executive director |
| 2. | How many years of experience do you have in pumping systems? 20 years |
| 3. | What types of experience do you have in pumping systems? |
| 4. | Which specific customer types/segments purchase "clean water pumps" as defined above? (Check all that apply) ☑ Agricultural ☑ Commercial ☑ Industrial ☑ Municipal ☑ Residential – multifamily ☑ Wastewater ☐ Other: Click or tap here to enter text. |
| _ | |
| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? ☑ Yes – different casing, different impeller □No |



| 6. | What percentage of customers are aware of the Department of Energy's pump efficiency index (PEI) rating for Pump Energy Conservation Standards: ☑ Less than 25% – End user / Contractor (installer) ☐ 25%-50% ☐ 50% - 75% ☑ 75%+ – Distributor ☐ Don't know ☐ Can provide later |
|-----|--|
| 7. | What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., $0.5-1.0$)? Responses may be specific PEI rating or one of the following ranges <0.8, $0.81-0.89$, 0.93 , $0.94-0.98$, $0.98-1.0$, I don't know |
| | a. 1–15 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know b. 15–50 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know c. 50–250 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know |
| 8. | What is the most commonly purchased PEI rating for variable speed pumps by rated motor HP range (e.g., 0.3 – 0.50)? Responses may be specific PEI rating or one of the following ranges <0.3, 0.31 – 0.39 , 0.40 – 0.43 , 0.44 – 0.48 , 0.48 – 0.50 , I don't know a. 1–15 horsepower: Click or tap here to enter text. \bigcirc <0.3 \bigcirc 0.31–0.39 \bigcirc 0.40–0.43 \bigcirc 0.44–0.48 \bigcirc 0.48–0.50 \boxtimes I don't know b. 15–50 horsepower: Click or tap here to enter text. \bigcirc <0.3 \bigcirc 0.31–0.39 \bigcirc 0.40–0.43 \bigcirc 0.44–0.48 \bigcirc 0.48–0.50 \boxtimes I don't know c. 50–250 horsepower: Click or tap here to enter text. \bigcirc <0.3 \bigcirc 0.31–0.39 \bigcirc 0.40–0.43 \bigcirc 0.44–0.48 \bigcirc 0.48–0.50 \boxtimes I don't know |
| 9. | If you specify pumps for customers, what are the key technical factors considered? Selection based on duty point, then compare PEI or energy rating a. Do you specify pump PEI ratings in selecting pumps for the customer? ☐ Yes ☑ No |
| 10. | When deciding on purchasing new or replacing pumps, what are the key factors considered? Availability a. Does pump PEI rating affect the customer's decision-making process when selecting a pump? ☐ Yes ☑ No ☐ I don't know [DoE posted a motor market assessment that give %] |
| 11. | What are the criteria customers consider when purchasing a pump? (e.g., initial cost, operating cost, reliability, past experience, efficiency, utility savings, product availability). ☑ Initial Cost – 3 ☑ Operating Cost/Efficiency – 4 ☑ Reliability – 4 |



| | ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency - 4 ☑ Availability - 2 ☑ Other: Form, fit, and function - 1 |
|--------|--|
| 12 | Are pump vendors you work with aware of PEI ratings of pumps? c. If so, what percent of their recommendations are efficient pumps? ☐ Less than 25% ☐ 25%-50% ☐ 50% - 75% ☒ 75%+ ☐ I don't know d. Are efficient pumps readily available for purchase? ☒ Yes ☐ No ☐ Not Sure |
| Interv | iew 7: VFD Vendor |
| 1. | What is your current title/role? Product manager / application engineer |
| 2. | How many years of experience do you have in pumping systems? 6–7years |
| 3. | What types of experience do you have in pumping systems? Systems integration/selection, component selection, and sales |
| 4. | Which of the following pump equipment classes does your company sell or for which you install VFDs? (Check all that apply) ☑ ESCC: end suction close coupled pump ☑ ESFM: end suction frame mounted pump ☑ IL: in-line close coupled and split coupled pumps ☑ RSV: radially split, multistage, vertical, in-line casing diffuser pump ☑ Submersible vertical turbines pump |
| 5. | Which sector(s) does your company sell/install VFDs for "clean water pumps", as defined above? (Check all that apply) ☑ Agricultural -1 ☑ Commercial -2 ☑ Industrial - 3 ☑ Municipal - 4 ☐ Residential ☑ Wastewater -5 ☐ Other: Click or tap here to enter text. |
| 6. | Are there variations in pump types in the wastewater customer segment versus other segments? ☑ Yes – wastewater – vertical turbines to submersible vert. pumps □No |



| 7. | What range of pump sizes (in rated-motor horsepower) does your company typically sell VFDs for? What is the most common size? [Note: Last three years is the preferred time period] ☑ 1-15 HP - famers imperial valley uses this range ☑ 15-50 HP - farmers big pump stations ☑ 50-250 HP Most common size sold - 50 - 250HP |
|-----|--|
| 8. | Are you aware of the Department of Energy's established metric, pump efficiency index (PEI) rating for Pumping System Energy Standards? \square Yes \square No |
| | Do you advise or recommend to potential customers selection of VFDs, and motors based on how it would affect their PEI ratings factor? ☐ Yes ☑ No |
| 10. | . Do PEI ratings factor into the customer decision-making process when purchasing a VFD for their pump? □ Yes ☑ No □ I don't know |
| | . Are PEI ratings specified in the customer's technical specifications or equipment order? \Box Yes $\ \boxtimes$ No $\ \Box$ I don't know |
| 12: | What are the most common pump manufacturer and models associated with the VFD projects completed in the last three years within the following ranges (up to three): a. 1–15 horsepower i. Gorman-rupp – will follow up with models ii. Click or tap here to enter text. iii. Click or tap here to enter text. b. 15–50 horsepower i. Click or tap here to enter text. ii. Click or tap here to enter text. iii. Click or tap here to enter text. |
| 13. | i. What is the relative quantity of VFDs sold annually by pump rated HP range? [Note: This is not the rated HP of the VFD, but of the pump motor. Last three years is the preferred time period] a. 1–15 horsepower 10s 100s 1000s |



| 14 | I. What is the PEI rating customers consider as efficient for variable speed pumps by rated HP range. Variable Speed 1–15 horsepower – Will follow up with model numbers Variable Speed 15–50 horsepower – Click or tap here to enter text. Variable Speed 50–250 horsepower – Click or tap here to enter text. |
|--------|--|
| 15 | 5. What percentage of sales do efficient pumps with variable load account for in the last three years? ☐ Less than 25% ☐ 25%-50% ☐ 50%-75% ☑ 75+% ☐ I don't know |
| 16 | S. What are the main factors that a customer considers when choosing a pump with VFD for installation? (E.g. Initial cost, operating cost, reliability, past experience, efficiency, utility savings, etc.) ☑ Initial Cost – 3 ☐ Operating Cost/Efficiency ☑ Reliability – 2 ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency – 1 ☐ Efficiency ☑ Availability – 4 ☐ Other: Click or tap here to enter text. |
| 17 | 7. Can we reach out to you to follow up if we have further questions? Yes |
| 18 | 3. Could you refer us to anyone knowledgeable about pumps that would be willing to participate in this survey? If so, could you share their contact information? Yes, provided |
| Interv | riew 8: Pump Vendor |
| 1. | What is your current title/role? Industry segment specialist |
| 2. | How many years of experience do you have in pumping systems? 11 years |
| 3. | What types of experience do you have in pumping systems? sales and consulting – food and beverage, chemical distribution, bio farm, sanitary, industrial |
| 4. | Which of the following pump equipment classes does your company sell/install? (Check all that apply) ☐ ESCC: end suction close coupled pump ☐ ESFM: end suction frame mounted pump |



| | ☐ IL: in-line close coupled and split coupled pumps ☐ RSV: radially split, multistage, vertical, in-line casing diffuser pump ☐ Submersible vertical turbines pump |
|-----|---|
| 5. | Which sector(s) does your company sell/install "clean water pumps" to, as defined above? (Check all that apply) Agricultural Commercial Industrial Municipal Residential Wastewater Other: Click or tap here to enter text. |
| 6. | Are there variations in pump types sold in the wastewater customer segment versus other segments? $\hfill Yes \\ \hfill No$ |
| 7. | What range of pump sizes (in rated-motor horsepower) does your company typically sell? What is the most common size? [Note: Last three years is the preferred time period] 1–15 HP 15–50 HP 50–250 HP Most common size sold – Click or tap here to enter text. |
| 8. | Are you aware of the Department of Energy's established metric, pump efficiency index (PEI rating for Pumping System Energy Standards? \Box Yes \Box No |
| 9. | Do you advise or recommend to potential customers selection of pumps based on their PEI ratings factor? \Box Yes \Box No |
| 10. | Do PEI ratings factor into the customer decision-making process when purchasing a pump? \Box Yes \Box No \Box I don't know |
| 11. | Are PEI ratings specified in the customer's technical specifications or equipment order? \Box Yes \Box No \Box I don't know |
| 12. | What are the most common sold/installed pump manufacturer and models in the last three years within the following ranges (up to three): a. 1–15 horsepower i. Click or tap here to enter text. ii.Click or tap here to enter text. iii.Click or tap here to enter text. b. 15–50 horsepower i. Click or tap here to enter text. |



| | C. | ii. Click or tap here to enter text. iii. Click or tap here to enter text. 50-250 horsepower i. Click or tap here to enter text. ii. Click or tap here to enter text. iii. Click or tap here to enter text. |
|-----|---|--|
| 13. | | at is the relative quantity of pumps sold annually by rated HP range? [Note: Last three is is the preferred time period] |
| | - | 1-15 horsepower |
| | a. | · |
| | h | ☐ 10s ☐ 100s ☒ 1000s ☐ Click or tap here to enter text. 15-50 horsepower |
| | b. | · |
| | _ | ☐ 10s ☐ 100s ☒ 1000s ☐ Click or tap here to enter text. |
| | C. | 50-250 horsepower |
| | | ☐ 10s ☐ 1000s ☐ Click or tap here to enter text. |
| | cor a. b. c. d. e. f. | s, to the above question, what is the PEI rating customer consider as efficient for stant and variable speed pumps by rated HP range. Constant Speed 1–15 horsepower – Will follow up with Tommy Constant Speed 15–50 horsepower – Click or tap here to enter text. Constant Speed 50–250 horsepower – Click or tap here to enter text. Variable Speed 1–15 horsepower – Click or tap here to enter text. Variable Speed 15–50 horsepower – Click or tap here to enter text. Variable Speed 50–250 horsepower – Click or tap here to enter text. |
| 15. | | at percentage of sales do efficient pumps account for in the last three years? ess than 25% 5%–50% 0%–75% 5+% don't know |
| 16. | | at are the main factors that a customer considers when choosing a pump for installation? Initial cost, operating cost, reliability, past experience, efficiency, utility savings, etc.) |
| | | nitial Cost – 3 perating Cost/Efficiency – 5 eliability – 1 rior Experience/Spare parts consistency/Manufacturer or type consistency – 6 ifficiency – 4 vailability – 2 |
| | If t | ey have time to plan out: |
| | | nitial Cost – 1 perating Cost/Efficiency – 2 |
| | | eliability – 4 |



☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency – 6

| X | Efficiency – 5 |
|---|--|
| X | Availability – 3 |
| | Other: Click or tap here to enter text |

Interview 9: Pump Manufacturer

- 1. What is your current title/role? Regional Sales Manager
- 2. How many years of experience do you have in pumping systems? **20** years
- What types of experience do you have in pumping systems?
 Centrifugal pumps, wastewater pumps, positive displacement pump manufacturer for industrial application
- 4. Which of the following pump equipment classes does your company sell? (Check all that apply)
 - **☒** ESCC: end suction close coupled pump
 - ☑ ESFM: end suction frame mounted pump
 - ☑ IL: in-line close coupled and split coupled pumps
 - RSV: radially split, multistage, vertical, in-line casing diffuser pump
 - ☑ Submersible vertical turbines pump motion industry also sells this one
- 5. Are there variations in pump types sold in the wastewater customer segment versus other segments?
 - oxtimes Yes food industry, oil and gas industry, FM approved pumps, chemical feed pumps \Box No
- 6. Which sector(s) does your company sell "clean water pumps" to, as defined above? (Check all that apply)
 - **⊠** Agricultural
 - **⊠** Commercial
 - **Industrial**
 - **⋈** Municipal
 - **⊠** Residential

 - ☐ Other: Click or tap here to enter text.
- 7. What range of pump sizes (in rated-motor horsepower) does your company typically sell? What is the most common size? [Note: Last three years is the preferred time period]
 - \boxtimes 1–15 horsepower 2
 - **⊠** 15-50 horsepower 1
 - **⋈** 50-250 horsepower 3

Most common size sold - Click or tap here to enter text.

8. Are you aware of the Department of Energy's established metric, pump efficiency index (PEI) rating for Pumping System Energy Standards?



| | ⊠ Yes □ No |
|---------|--|
| 9. | Do you advise or recommend to potential customers selection of pumps based on their PEI ratings factor? |
| | ☐ Yes ☒ No - sometimes an engineer might have it in a spec |
| 10 | . Do PEI ratings factor into the customer decision–making process when purchasing a pump? \boxtimes Yes \square No \square I don't know – varies by municipality and budget size |
| 11 | . Are PEI ratings specified in the customer's technical specifications or equipment order? $\hfill\Box$ Yes \hfill No \hfill I don't know |
| 12 | . What are the most commonly sold pump models in the last 12 months within the following ranges (up to three): a. 1–15 horsepower i.Tommy from motion will follow up ii.Click or tap here to enter text. iii.Click or tap here to enter text. b. 15–50 horsepower i.Click or tap here to enter text. ii.Click or tap here to enter text. iii.Click or tap here to enter text. c. 50–250 horsepower i.Click or tap here to enter text. ii.Click or tap here to enter text. iii.Click or tap here to enter text. iii.Click or tap here to enter text. iii.Click or tap here to enter text. |
| 13. | . What is the relative quantity of pumps sold annually by rated HP range? [Note: Last three years is the preferred time period] a. 1–15 horsepower □ 10s □ 100s ⋈ 1000s b. 15–50 horsepower □ 10s □ 100s ⋈ 1000s c. 50–250 horsepower □ 10s ⋈ 100s □ 1000s |
| Intervi | iew 10: Pump Manufacturer |
| 1. | What is your current title/role? Regional Sales Manager |
| 2. | How many years of experience do you have in pumping systems? 15 years |

- 3. What types of experience do you have in pumping systems?

 Consultant firm for energy sector, water treatment, business development, product management
- 4. Which of the following pump equipment classes does your company sell? (Check all that apply)



| | ☑ ESCC: end suction close coupled pump ☑ ESFM: end suction frame mounted pump ☑ IL: in-line close coupled and split coupled pumps ☑ RSV: radially split, multistage, vertical, in-line casing diffuser pump ☑ Submersible vertical turbines pump – motion industry also sells this one |
|-----|--|
| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? ☑ Yes – food industry, oil and gas industry, FM approved pumps, chemical feed pumps □ No |
| 6. | Which sector(s) does your company sell "clean water pumps" to, as defined above? (Check all that apply) ☑ Agricultural ☑ Commercial ☑ Industrial ☑ Municipal ☑ Residential ☑ Wastewater ☐ Other: Click or tap here to enter text. |
| 7. | What range of pump sizes (in rated-motor horsepower) does your company typically sell? What is the most common size? [Note: Last three years is the preferred time period] ☑ 1-15 horsepower - 2 ☑ 15-50 horsepower - 1 ☑ 50-250 horsepower - 3 Most common size sold - Click or tap here to enter text. |
| 8. | Are you aware of the Department of Energy's established metric, pump efficiency index (PEI) rating for Pumping System Energy Standards? $\ \ \ \ \ \ \ \ \ \ \ \ \ $ |
| 9. | Do you advise or recommend to potential customers selection of pumps based on their PEI ratings factor? \square Yes \square No - sometimes an engineer might have it in a spec |
| 10. | Do PEI ratings factor into the customer decision-making process when purchasing a pump? \boxtimes Yes \square No \square I don't know – varies by municipality and budget size |
| 11. | Are PEI ratings specified in the customer's technical specifications or equipment order? \square Yes \square No \square I don't know |
| 12. | What are the most commonly sold pump models in the last 12 months within the following ranges (up to three): a. 1–15 horsepower ii.Tommy from motion will follow up iii.Click or tap here to enter text. |



| | iv.Click or tap here to enter text. b. 15–50 horsepower ii.Click or tap here to enter text. iii.Click or tap here to enter text. iv.Click or tap here to enter text. c. 50–250 horsepower ii.Click or tap here to enter text. iii.Click or tap here to enter text. iv.Click or tap here to enter text. |
|--|--|
| 13 | . What is the relative quantity of pumps sold annually by rated HP range? [Note: Last three years is the preferred time period] b. 1–15 horsepower □ 10s □ 100s ☒ 1000s c. 15–50 horsepower □ 10s □ 100s ☒ 1000s d. 50–250 horsepower □ 10s ☒ 100s □ 1000s |
| Interview 11: Pump Vendor 1. What is your current title/role? Industry Initiatives specialist | |
| 2. | How many years of experience do you have in pumping systems? 9 years |
| 3. | What types of experience do you have in pumping systems? Sales – food and beverage |
| 5. | Which of the following pump equipment classes does your company sell/install? (Check all that apply) □ ESCC: end suction close coupled pump □ ESFM: end suction frame mounted pump □ IL: in-line close coupled and split coupled pumps □ RSV: radially split, multistage, vertical, in-line casing diffuser pump □ Submersible vertical turbines pump |
| 6. | Which sector(s) does your company sell/install "clean water pumps" to, as defined above? (Check all that apply) Agricultural Commercial Industrial Municipal Residential Wastewater Other: Click or tap here to enter text. |



| 7. | Are there variations in pump types sold in the wastewater customer segment versus other segments? ☐ Yes ☐ No |
|-----|--|
| 8. | What range of pump sizes (in rated-motor horsepower) does your company typically sell? What is the most common size? [Note: Last three years is the preferred time period] □ 1-15 HP □ 15-50 HP □ 50-250 HP Most common size sold - Click or tap here to enter text. |
| 9. | Are you aware of the Department of Energy's established metric, pump efficiency index (PEI rating for Pumping System Energy Standards? \Box Yes \Box No |
| 10. | . Do you advise or recommend to potential customers selection of pumps based on their PEI ratings factor? \Box Yes \Box No |
| 11. | . Do PEI ratings factor into the customer decision-making process when purchasing a pump? \Box Yes \Box No \Box I don't know |
| 12. | . Are PEI ratings specified in the customer's technical specifications or equipment order? $\hfill\Box$ Yes $\hfill\Box$ No $\hfill\Box$ I don't know |
| 13. | . What are the most common sold/installed pump manufacturer and models in the last three years within the following ranges (up to three): b. 1–15 horsepower iv. Click or tap here to enter text. v.Click or tap here to enter text. vi.Click or tap here to enter text. c. 15–50 horsepower i. Click or tap here to enter text. ii. Click or tap here to enter text. iii. Click or tap here to enter text. iiii. Click or tap here to enter text. |
| 14. | . What is the relative quantity of pumps sold annually by rated HP range? [Note: Last three years is the preferred time period] b. 1–15 horsepower |
| | □ 10s □ 100s □ 100s □ Click or tap here to enter text. c. 15-50 horsepower □ 10s □ 100s □ 100s □ Click or tap here to enter text. c. 50-250 horsepower |
| | c. 50–250 horsepower □ 10s ☑ 100s □ 1000s □ Click or tap here to enter text. |



- 15. If yes, to the above question, what is the PEI rating customer consider as efficient for constant and variable speed pumps by rated HP range.
 - b. Constant Speed 1–15 horsepower Will follow up with Tommy
 - c. Constant Speed 15–50 horsepower Click or tap here to enter text.
 - d. Constant Speed 50–250 horsepower Click or tap here to enter text.
 - e. Variable Speed 1–15 horsepower Click or tap here to enter text.
 - f. Variable Speed 15–50 horsepower Click or tap here to enter text.
 - g. Variable Speed 50–250 horsepower Click or tap here to enter text.

| 16. What percentage of sales do efficient pumps account for in the last three years? ☐ Less than 25% ☐ 25%-50% ☐ 50%-75% ☐ 75+% ☐ I don't know |
|--|
| 17. What are the main factors that a customer considers when choosing a pump for installation (E.g., Initial cost, operating cost, reliability, past experience, efficiency, utility savings, etc.) |
| ☑ Initial Cost – 3 ☑ Operating Cost/Efficiency – 5 ☑ Reliability – 1 ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency – 6 ☑ Efficiency – 4 ☑ Availability – 2 |
| If they have time to plan out: ☑ Initial Cost – 1 ☑ Operating Cost/Efficiency – 2 ☑ Reliability – 4 ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency – 6 ☑ Efficiency – 5 ☑ Availability – 3 ☐ Other: Click or tap here to enter text. |

Interview 12: Pump Manufacturer

- 1. What is your current title/role?
 - **Regional Sales Manager**
- 2. How many years of experience do you have in pumping systems? **15** years
- 3. What types of experience do you have in pumping systems?

 Consultant firm for energy sector, water treatment, business development, product management



| 4. | Which of the following pump equipment classes does your company sell? (Check all that ☑ ESCC: end suction close coupled pump ☑ ESFM: end suction frame mounted pump ☑ IL: in-line close coupled and split coupled pumps ☑ RSV: radially split, multistage, vertical, in-line casing diffuser pump ☑ Submersible vertical turbines pump – motion industry also sells this one |
|-----|---|
| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? ☑ Yes – food industry, oil and gas industry, FM approved pumps, chemical feed pumps □ No |
| 6. | Which sector(s) does your company sell "clean water pumps" to, as defined above? (Check all that apply) ☑ Agricultural ☑ Commercial ☑ Industrial ☑ Municipal ☑ Residential ☑ Wastewater ☐ Other: Click or tap here to enter text. |
| 7. | What range of pump sizes (in rated-motor horsepower) does your company typically sell? What is the most common size? [Note: Last three years is the preferred time period] ☑ 1-15 horsepower - 2 ☑ 15-50 horsepower - 1 ☑ 50-250 horsepower - 3 Most common size sold - Click or tap here to enter text. |
| 8. | Are you aware of the Department of Energy's established metric, pump efficiency index (PEI rating for Pumping System Energy Standards? $\ \ \ \ \ \ \ \ \ \ \ \ \ $ |
| 9. | Do you advise or recommend to potential customers selection of pumps based on their PEI ratings factor? ☐ Yes ☑ No - sometimes an engineer might have it in a spec |
| 10. | Do PEI ratings factor into the customer decision-making process when purchasing a pump? \boxtimes Yes \square No \square I don't know – varies by municipality and budget size |
| 11. | Are PEI ratings specified in the customer's technical specifications or equipment order? \square Yes \square No \square I don't know |
| 12. | What are the most commonly sold pump models in the last 12 months within the following ranges (up to three): b. 1–15 horsepower iii. Tommy from motion will follow up |



| | iv.Click or tap here to enter text. v.Click or tap here to enter text. |
|--------|---|
| | c. 15–50 horsepower |
| | iii.Click or tap here to enter text. |
| | iv.Click or tap here to enter text. |
| | v.Click or tap here to enter text. |
| | d. 50–250 horsepower |
| | iii.Click or tap here to enter text. |
| | iv.Click or tap here to enter text. |
| | v.Click or tap here to enter text. |
| 13 | . What is the relative quantity of pumps sold annually by rated HP range? [Note: Last three |
| | years is the preferred time period] |
| | c. 1-15 horsepower |
| | □ 10s □ 100s ⋈ 1000s |
| | d. 15-50 horsepower |
| | □ 10s □ 100s ⋈ 1000s |
| | e. 50–250 horsepower |
| | □ 10s 🖾 100s □ 1000s |
| Interv | iew 13: Subject Matter Expert |
| 1 | What is your current title/role? |
| | VP of Business Development |
| | |
| 2. | How many years of experience do you have in pumping systems? |
| | 19 years |
| 3. | What types of experience do you have in pumping systems? |
| | Consultant for 13 yrs designing pumping stations, water and wastewater systems, current |
| | focusing on optimization of those systems. |
| 1 | Which specific customer types/segments purchase "clean water pumps" as defined above? |
| 4. | (Check all that apply) |
| | ✓ Agricultural |
| | ☑ Commercial |
| | ☑ Industrial |
| | ☑ Municipal – experience lies here |
| | ✓ Residential |
| | ☑ Wastewater – experience lies here |
| | • |
| | ☐ Other: Click or tap here to enter text. |
| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? |
| | ☑ Yes – wastewater have a larger passthrough capacity, direct inlet (no screening) on vert turbine pump. At wastewater treatment plants, the effluent of the primary treatment process can be pumped with clean pumps. □No |



| | What percentage of customers are aware of the Departm index (PEI) rating for Pump Energy Conservation Standard Less than 25% ☐ 25%-50% ☐ 50%-75% ☐ 75%+ ☐ Don't know ☐ Can provide later | ds: | |
|----|--|---|--|
| 7. | What is the most commonly purchased PEI rating for cons HP range (e.g., 0.5–1.0)? Responses may be specific PEI rating or one of the follow 0.93, 0.94–0.98, 0.98–1.0, I don't know a. 1–15 horsepower: Click or tap here to enter text. | | |
| | □ <0.8 □ 0.81-0.89 □ 0.90-0.93 □ 0.94-0.98 | □ 0.98-1.0 | ☑ I don't know |
| | b. $15-50$ horsepower: Click or tap here to enter text. $\square < 0.8 \square 0.81-0.89 \square 0.90-0.93 \square 0.94-0.98$ c. $50-250$ horsepower: Click or tap here to enter text. | □ 0.98-1.0 | ⊠ I don't know |
| | □ <0.8 □ 0.81-0.89 □ 0.90-0.93 □ 0.94-0.98 | □ 0.98-1.0 | 図 I don't know |
| 8. | What is the most commonly purchased PEI rating for variant HP range (e.g., 0.3–0.50)? Responses may be specific PEI rating or one of the follow 0.43, 0.44–0.48, 0.48–0.50, I don't know | | |
| | a. 1-15 horsepower: Click or tap here to enter text. $\square < 0.3 \square \ 0.31 - 0.39 \square \ 0.40 - 0.43 \square \ 0.44 - 0.48$ b. 15-50 horsepower: Click or tap here to enter text. $\square < 0.3 \square \ 0.31 - 0.39 \square \ 0.40 - 0.43 \square \ 0.44 - 0.48$ c. 50-250 horsepower: Click or tap here to enter text. $\square < 0.3 \square \ 0.31 - 0.39 \square \ 0.40 - 0.43 \square \ 0.44 - 0.48$ | □ 0.48-0.50 □ 0.48-0.50 □ 0.48-0.50 |) ⊠ I don't know |
| 9. | If you specify pumps for customers, what are the key tech Preferred operating range should operate in the 70% to 1 operation curve. Ensure the pump selection has sufficien to be appropriate for adding a VFD. a. Do you specify pump PEI ratings in selecting pumps for \square Yes \square No | .20% of best ef t coverage thro | ficiency point of the ough the pump curve |
| 10 | . When deciding on purchasing new or replacing pumps, w considered? Preferred operating range that will give flow and head the ROI | nat they need, h | nydraulic capacity, |
| | a. Does pump PEI rating affect the customer's decision-pump? ☐ Yes ☒ No ☐ I don't know | making proces | s when selecting a |



| 11. | What are the criteria customers consider when purchasing a pump? (e.g., initial cost, operating cost, reliability, past experience, efficiency, utility savings, product availability). [Note: Ask to see if they can provide ranking from most important to least important] ☑ Initial Cost - 2 ☑ Operating Cost/Efficiency - 5 ☑ Reliability - 4 ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency - 1 ☑ Availability - 3 ☑ Other: Hydraulic modeling for system compatibility, | |
|-------------------------------------|---|--|
| 12 | Are pump vendors you work with aware of PEI ratings of pumps? a. If so, what percent of their recommendations are efficient pumps? □ Less than 25% □ 25%-50% □ 50% - 75% □ 75%+ ☑ I don't know | |
| | b. Are efficient pumps readily available for purchase?☑ Yes □ No □ Not Sure | |
| Interview 14: Subject Matter Expert | | |
| 1. | What is your current title/role? Chief Water Treatment Operator | |
| 2. | How many years of experience do you have in pumping systems? 19 years | |
| 3. | What types of experience do you have in pumping systems? Water treatment and pumping operations, extensively in groundwater wells, vertical turbines, booster pumps, in-line and split case pumps. No experience in wastewater treatment. | |
| 4. | Which specific customer types/segments purchase "clean water pumps" as defined above? (Check all that apply) ☐ Agricultural ☑ Commercial ☑ Industrial ☑ Municipal ☑ Residential ☐ Wastewater ☐ Other: Click or tap here to enter text. Customer does not have experience with Agricultural and Wastewater segments. | |
| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? $\hfill\Box$ Yes | |



| | □ No Not applicable | | | | |
|-----|--|--|--|--|--|
| 6. | What percentage of customers are aware of the Department of Energy's pump Energy index (PEI) rating for Pump Energy Conservation Standards: ☐ Less than 25% ☐ 25%-50% ☐ 50%-75% ☐ 75%+ ☐ Don't know ☐ Can provide later | | | | |
| 7. | What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., $0.5-1.0$)? Responses may be specific PEI rating or one of the following ranges <0.8, $0.81-0.89$, $0.90-0.93$, $0.94-0.98$, $0.98-1.0$, I don't know | | | | |
| | a. 1–15 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know b. 15–50 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know c. 50–250 horsepower: Click or tap here to enter text. □ <0.8 □ 0.81–0.89 □ 0.90–0.93 □ 0.94–0.98 □ 0.98–1.0 ☑ I don't know | | | | |
| 8. | 3. What is the most commonly purchased PEI rating for variable speed pumps by rated motor HP range (e.g., 0.3–0.50)? Responses may be specific PEI rating or one of the following ranges <0.3, 0.31–0.39, 0.400.43, 0.44–0.48, 0.48–0.50, I don't know | | | | |
| | a. 1-15 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31-0.39 □ 0.40-0.43 □ 0.44-0.48 □ 0.48-0.50 ☑ I don't know b. 15-50 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31-0.39 □ 0.40-0.43 □ 0.44-0.48 □ 0.48-0.50 ☑ I don't know c. 50-250 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31-0.39 □ 0.40-0.43 □ 0.44-0.48 □ 0.48-0.50 ☑ I don't know | | | | |
| 9. | If you specify pumps for customers, what are the key technical factors considered? a. Do you specify pump PEI ratings in selecting pumps for the customer? ☐ Yes ☑ No but looking to specify that in the future. | | | | |
| 10. | When deciding on purchasing new or replacing pumps, what are the key factors considered? a. Does pump PEI rating affect the customer's decision-making process when selecting a pump? □ Yes ☑ No □ I don't know | | | | |



but looking to specify that in the future.

| | b. | What are the criteria customers consider when purchasing a pump? (e.g., initial cost, operating cost, reliability, past experience, efficiency, utility savings, product availability). | | | |
|--------|--|--|--|--|--|
| | | ☑ Initial Cost - 1 | | | |
| | | □ Operating Cost/Efficiency – 2 | | | |
| | | ⊠ Reliability – 4 | | | |
| | | ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency – 5 | | | |
| | | | | | |
| | | ☐ Other: Click or tap here to enter text. | | | |
| 11 | Are | e pump vendors you work with aware of PEI ratings of pumps? | | | |
| | a. | If so, what percent of their recommendations are efficient pumps? | | | |
| | | ☐ Less than 25% | | | |
| | | □ 25%-50% | | | |
| | | □ 50%-75% | | | |
| | | ⊠ 75%+ (Typical pump contractors include General Pump Co.) | | | |
| | | ☐ I don't know | | | |
| | b. | Are efficient pumps readily available for purchase? | | | |
| | | | | | |
| | Faced some supply chain issues during the pandemic, but no longer an issue | | | | |
| 12 | Ca Ye | n we reach out to you to follow up if we have further questions? s | | | |
| 13 | in | ould you refer us to anyone knowledgeable about pumps that would be willing to participate this survey? If so, could you share their contact information? s, will refer to others. | | | |
| Interv | iew | 15: Subject Matter Expert | | | |
| 1. | | nat is your current title/role? nior Program Manager | | | |
| 2. | | w many years of experience do you have in pumping systems? years | | | |
| 3. | Pro co ho | nat types of experience do you have in pumping systems? ogram development; RTF – research planning, operating info – 400 pumps in NW, data llection and record keeping; pump characteristic data, load profiles and operational urs. Study published in NEEA. Launched a midstream program; recruiting and engage an reps, EE, PEI, etc. | | | |
| 4. | (Cl | nich specific customer types/segments purchase "clean water pumps" as defined above? neck all that apply) Agricultural | | | |



⊠ Commercial

| | ☑ Industrial ☑ Municipal ☑ Residential ☐ Wastewater *end of process ☐ Other: Click or tap here to enter text. |
|----|---|
| 5. | Are there variations in pump types sold in the wastewater customer segment versus other segments? \boxtimes Yes \square No |
| 6. | What percentage of customers are aware of the Department of Energy's pump energy index (PEI) rating for Pump Energy Conservation Standards: ☐ Less than 25% ☐ 25%-50% ☐ 50%-75% ☒ 75%+ ☐ Don't know ☐ Can provide later |
| 7. | What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., $0.5-1.0$)? Responses may be specific PEI rating or one of the following ranges <0.8, $0.81-0.89$, $0.90-0.93$, $0.94-0.98$, $0.98-1.0$, I don't know a. $1-15$ horsepower: Click or tap here to enter text. |
| 8. | What is the most commonly purchased PEI rating for variable speed pumps by rated motor HP range (e.g., $0.3-0.50$)? Responses may be specific PEI rating or one of the following ranges <0.3, $0.31-0.39$, $0.40-0.43$, $0.44-0.48$, $0.48-0.50$, I don't know a. $1-15$ horsepower: Click or tap here to enter text. |
| | know |

9. What are the most commonly sold pump models in the last 12 months within the following ranges (up to three):



| | b. 2 | 1–15 horsepower i. TACO, Grundfos, Armstrong, Wilo, Bell & Gossett 15–50 horsepower i. TACO, Grundfos, Armstrong, Wilo, Bell & Gossett 50–250 horsepower i. |
|-----|-------------------|--|
| 10. | - | ou specify pumps for customers, what are the key technical factors considered? Do you specify pump PEI ratings in selecting pumps for the customer? □ Yes ☑ No operational specifications are priority |
| 11. | | en deciding on purchasing new or replacing pumps, what are the key factors nsidered? Does pump PEI rating affect the customer's decision-making process when selecting a pump? □ Yes 🗵 No □ I don't know |
| | b. | What are the criteria customers consider when purchasing a pump? (e.g., initial cost, operating cost, reliability, past experience, efficiency, utility savings, product availability). ☑ Initial Cost − 2 ☑ Operating Cost/Efficiency − 3 ☑ Reliability − 1 ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency − 4 ☑ Availability − 5 ☐ Other: Click or tap here to enter text. − Pump Fit, right pump for the job − 1 |
| 12. | a. | pump vendors you work with aware of PEI ratings of pumps? 75+ aware If so, what percent of their recommendations are efficient pumps? □ Less than 25% ☑ 25%-50% - for constant speed pumps; 0.92 or better PEI □ 50% - 75% ☑ 75%+ - for Variable; 0.48 or better PEI, all smart pumps □ I don't know Are efficient pumps readily available for purchase? ☑ Yes □ No □ Not Sure |
| 13. | Car Yes | n we reach out to you to follow up if we have further questions? |
| 14. | | uld you refer us to anyone knowledgeable about pumps that would be willing to participate this survey? If so, could you share their contact information? |

Interview 16: Subject Matter Expert

What is your current title/role?
 Operations Manager - Water Treatment



| 2. | How many years of experience do you have in pumping systems? 15 years | | | | |
|--|--|--|--|--|--|
| 4. | What types of experience do you have in pumping systems? Supervising districts production, Management of pump operating systems including engineering, the repair and upgrade of both well pumps and booster pumps. Management of water treatment for pumping system involved with source water distribution. | | | | |
| 5. | Which specific customer types/segments purchase "clean water pumps" as defined above? (Check all that apply) ☑ Agricultural ☑ Commercial ☑ Industrial ☑ Municipal ☑ Residential ☐ Wastewater ☐ Other: Click or tap here to enter text. | | | | |
| 6. Are there variations in pump types sold in the wastewater customer segment vers segments?☑ Yes☐No | | | | | |
| | I have less experience with wastewater pumping, but there are submersible chopper pumps for example that are more commonly used for sewage and wastewater. | | | | |
| 7. | What percentage of customers are aware of the Department of Energy's pump energy index (PEI) rating for Pump Energy Conservation Standards: ☐ Less than 25% ☐ 25%-50% ☐ 50%-75% ☐ 75%+ ☑ Don't know ☐ Can provide later | | | | |
| 8. | What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., 0.5–1.0)? Responses may be specific PEI rating or one of the following ranges <0.8, 0.81–0.89, 0.90–0.93, 0.94–0.98, 0.98–1.0, I don't know b. 1–15 horsepower: Click or tap here to enter text. | | | | |
| | □ <0.8 $□$ 0.81-0.89 $□$ 0.90-0.93 $□$ 0.94-0.98 $□$ 0.98-1.0 $⊠$ I don't know c. 15-50 horsepower: Click or tap here to enter text. | | | | |
| | \square <0.8 \square 0.81-0.89 \square 0.90-0.93 \square 0.94-0.98 \square 0.98-1.0 \boxtimes I don't know | | | | |
| | d. $50-250$ horsepower: Click or tap here to enter text. $\square < 0.8 \square 0.81-0.89 \square 0.90-0.93 \square 0.94-0.98 \square 0.98-1.0 \boxtimes \ \textbf{I don't know}$ | | | | |
| 9. | What is the most commonly purchased PEI rating for variable speed pumps by rated motor | | | | |



HP range (e.g., 0.3-0.50)?

| | 0.43, 0.44-0.48, 0.48-0.50, I don't know | | | | | | |
|-----|--|--|--|--|--|--|--|
| | b. 1–15 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31–0.39 □ 0.40–0.43 □ 0.44–0.48 □ 0.48–0.50 ⊠ I don't | | | | | | |
| | know c. 15-50 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31-0.39 □ 0.40-0.43 □ 0.44-0.48 □ 0.48-0.50 図 I don't | | | | | | |
| | know d. 50-250 horsepower: Click or tap here to enter text. □ <0.3 □ 0.31-0.39 □ 0.40-0.43 □ 0.44-0.48 □ 0.48-0.50 ☑ I don't know | | | | | | |
| 11. | If you specify pumps for customers, what are the key technical factors considered? b. Do you specify pump PEI ratings in selecting pumps for the customer? ☐ Yes 図 No | | | | | | |
| 12. | 2. When deciding on purchasing new or replacing pumps, what are the key factors considered? b. Does pump PEI rating affect the customer's decision-making process when selecting a pump? ☐ Yes ☑ No ☐ I don't know | | | | | | |
| | c. What are the criteria customers consider when purchasing a pump? (e.g., initial cost, operating cost, reliability, past experience, efficiency, utility savings, product availability). ☑ Initial Cost - 1 ☑ Operating Cost/Efficiency - 1 ☑ Reliability - 3 ☑ Prior Experience/Spare parts consistency/Manufacturer or type consistency - 2 ☑ Availability - 4 ☐ Other: Click or tap here to enter text. | | | | | | |
| 13. | 3. Are pump vendors you work with aware of PEI ratings of pumps? 75+ aware b. If so, what percent of their recommendations are efficient pumps? Less than 25% 25%-50% 50%-75% 75%+ I don't know c. Are efficient pumps readily available for purchase? Yes \(\subseteq \text{Not Sure} \) | | | | | | |
| 14. | 4. Can we reach out to you to follow up if we have further questions? Yes | | | | | | |
| 15. | 5. Could you refer us to anyone knowledgeable about pumps that would be willing to participate | | | | | | |

Responses may be specific PEI rating or one of the following ranges < 0.3, 0.31 – 0.39, 0.40 –



in this survey? If so, could you share their contact information?

Yes

Interview 17: Subject Matter Expert

| 2. | What is your current title/role? Operations Manager – Production |
|----|--|
| 3. | How many years of experience do you have in pumping systems? 15 years |
| 5. | What types of experience do you have in pumping systems? Supervising districts production, Management of pump operating systems including engineering, the repair and upgrade of both well pumps and booster pumps. |
| 6. | Which specific customer types/segments purchase "clean water pumps" as defined above? (Check all that apply) ☑ Agricultural ☑ Commercial ☑ Industrial ☑ Municipal ☑ Residential ☐ Wastewater ☐ Other: Click or tap here to enter text. |
| 7. | Are there variations in pump types sold in the wastewater customer segment versus other segments? ☑ Yes □No |
| | I have less experience with wastewater pumping, but there are submersible chopper pumps for example that are more commonly used for sewage and wastewater. |
| 8. | What percentage of customers are aware of the Department of Energy's pump energy index (PEI) rating for Pump Energy Conservation Standards: ☐ Less than 25% ☐ 25%-50% ☐ 50%-75% ☐ 75%+ ☐ Don't know ☐ Can provide later |
| 9. | What is the most commonly purchased PEI rating for constant speed pumps by rated motor HP range (e.g., $0.5-1.0$)? Responses may be specific PEI rating or one of the following ranges <0.8, $0.81-0.89$, $0.90-0.93$, $0.94-0.98$, $0.98-1.0$, I don't know c. $1-15$ horsepower: Click or tap here to enter text. \square <0.8 \square 0.81-0.89 \square 0.90-0.93 \square 0.94-0.98 \square 0.98-1.0 \boxtimes I don't know d. 15-50 horsepower: Click or tap here to enter text |



| | Δ | | | ck or tap here to | | □ 0.98-1.0 | ⊠ I don't knov |
|-----|--|--|--|---|----------------------|-----------------|----------------|
| | 0. | | | □ 0.90-0.93 | | □ 0.98-1.0 | ⊠ I don't know |
| 10. | 10. What is the most commonly purchased PEI rating for variable speed pumps by ra HP range (e.g., 0.3–0.50)? Responses may be specific PEI rating or one of the following ranges <0.3, 0.31–0.43, 0.44–0.48, 0.48–0.50, I don't know | | | | | • | |
| | c. | □ <0.3 | = | or tap here to er | | □ 0.48-0.50 | ⊠ I don't |
| | | 15-50 ho □ <0.3 | - | k or tap here to \Box 0.40–0.43 | | □ 0.48-0.50 | ⊠ I don't |
| | | 50-250 □ □ <0.3 | • | ck or tap here to □ 0.40-0.43 | | □ 0.48-0.50 | ⊠ I don't |
| 12. | - | | pecify pump PE | tomers, what are I ratings in select | • | | dered? |
| 13. | 3. When deciding on purchasing new or replacing pumps, what are the key factors considered? c. Does pump PEI rating affect the customer's decision-making process when selecting pump? ☐ Yes 図 No ☐ I don't know | | | | | | |
| | d. | operating availabilit ☑ Initial ○ ☑ Operat ☑ Reliab ☑ Prior E ☑ Availal | g cost, reliability ty). Cost – 1 ting Cost/Efficion ility – 3 experience/Spa | re parts consiste | e, efficiency, utili | ty savings, pro | duct |
| 14. | | | at percent of the nan 25% 50% 75% | with aware of PE eir recommendat | | | |
| | d. | Are efficie | | lily available for բ Sure | ourchase? | | |



- 15. Can we reach out to you to follow up if we have further questions? Yes
- 16. Could you refer us to anyone knowledgeable about pumps that would be willing to participate in this survey? If so, could you share their contact information?

 Yes

